

دوكاب Ducab

كابلات الجهد المنخفض XLPE Insulated Low Voltage Cables



حلول متقدمة للكابلات من خلال التقنية والابداع
Advanced Cable Solutions Through Technology and Innovation

BICC

CONTENTS

	PAGE
Introduction.....	1
Customer Service.....	2-3
Product Range	4
Specification and Construction	4-6
Salient Features of Ducab Cables Design.....	7
Installation and Electrical Data	7-19
XLPE Insulated Cables to BS 5467: Technical Data Tables.....	20-35
600/1000V rated, Copper and Aluminium Conductors.....	20-31
◆ Single Core Cables	20-21
◆ Two Core Cables	22-23
◆ Three Core Cables.....	24-25
◆ Four Core Cables	26-27
Four Core Cables with Reduced Neutral Conductors	28-29
Three and Four Core Armoured Cables	30-31
1900/3300V rated, Armoured Copper Conductors	32
XLPE insulated Lead Sheathed Armoured Cables to BS 5467.....	33-35
XLPE Cable Voltage Drop Data for partial loads.....	36-37
Components Reference Chart	38-40

Ducab is listed in the following publication issued by the Department of Trade and Industry of the United Kingdom.

“THE DTI QA REGISTER - PRODUCTS AND SERVICES LIST”

Only those companies whose quality system is assessed and certified by U.K. accredited certification bodies appear in the above publication.

INTRODUCTION

Established in 1979, Ducab is the leading cable manufacturing company in the region and is equally owned by the Governments of Dubai and Abu Dhabi. Ducab has 3 manufacturing sites and 6 independent manufacturing facilities that support its continuous growth, one in Jebel Ali and two in Abu Dhabi Industrial City. Ducab-HV, inaugurated in November 2011, is a joint venture between Ducab, ADWEA and DEWA offering High Voltage cable systems up to 400 kV. Ducab-HV will sell cable systems in the voltage range 66kV (66,000 Volts) to 400 kV (400,000 Volts) covering the highest voltage currently used in the GCC.

To meet the growing demand of customers around the region and the world, Ducab continues to expand its world-class facilities across the Middle East, North Africa, Europe, Australia and India. Ducab prides itself on setting and maintaining the highest quality standards of power cables. Experienced and highly skilled employees operate state-of-the-art equipment, and conduct extensive testing at every phase of production.

When it comes to advanced cable solutions, Ducab continues its status as the superbrand across the world in 40 countries. Ducab product range covers High Voltage cables up to 400 kV, Ducab Powerplus Medium Voltage cables up to 33 kV, Low Voltage power cables, Control & Auxiliary, Wiring and Lead-Sheathed cables, Ducab Smokemaster - Low Smoke Zero Halogen (LSZH) Cables, THHN/THWN cables, DuFlex cables, Instrumentation and Pilot cables, FlamBICC (Fire Resistant Cables), Cable components and cable accessories, Installation of cables, as well as Copper rod manufactured in Ducab's own Copper rod plant.

This catalogue provides working information on XLPE cables. Separate catalogues are available for the remaining range of Ducab Cables.

ORDERING ADVICE

Due to the wide range of cables in the catalogue, it is advisable, when ordering, to provide as much information as possible. Please use the following table as a guide:

1. Length of cables required and individual drum lengths.*
2. Voltage designation.
3. Number of cores.
4. Conductor size.
5. Colour of outer sheath.
7. Any other special requirement, e.g. circular conductors, special PVC special material, drum weight limitation etc.

* Cables are normally supplied in lengths of 100 metres, 500 metres and 1000 metres depending on conductor size. Other lengths can be supplied if required.

Please note depending on cable type requirement the ordering advice may change.

TECHNICAL ADVISORY SERVICE

For any specialist advice and assistance on the entire Ducab product range contact the Technical Department, Dubai Cable Company (Private) Limited, P. O. Box 11529, Dubai, U. A. E., Tel: 971-4-815 8888, Fax: 971-4-815 8111.

CUSTOMER SERVICE

Ducab is the premier cable manufacturer in the United Arab Emirates and, since 1979, has been meeting the requirements of customers throughout the GCC, Middle East and Asian markets. Ducab cables are preferred for the following reasons:

Ducab as the premier cable manufacturer in the United Arab Emirates also offer cable application based design solutions, upgrading cable specifications, cable material testing to assess remaining life, as well as Type Testing for customers throughout the GCC and Middle East market.

PRODUCT QUALITY

Ducab is committed to supplying its customers with the highest quality of product and of service. Ducab's cables have been type approved by recognized certifying bodies such as BASEC UK (British Approval Service for Cables), Lloyd's Register of the UK, KEMA Netherland, LPCB UK (Loss Prevention Certification Board), ESMA (Emirates Authority for standardization and Metrology), Kinectrics Nuclear Cable test lab in Canada Cables fully conform to BS, IEC, NEMA, ASTM, AEIC and other national and international specifications.

RELIABILITY



Specifying the right cable for a particular application is the first step. The key to reliability however, is in the manufacturing process. The cable must be free from material and manufacturing defects, and weaknesses that will be revealed in service.

Ducab constantly monitors its manufacturing processes and operates stringent quality assurance procedures to give long term reliability. Advance test equipment and traceability systems enable Ducab to prevent Counterfeit, Fraudulent and Suspected Items (CFSI). This is of vital significance where cables are to be installed in locations where future access would be difficult and this is where Ducab's reputation and resources give peace of mind.

PERFORMANCE

Optimum cable performance is provided by Ducab, with access to the latest developments in materials technology. In addition, Ducab's knowledge of the local environment, high ambient temperatures, corrosive soil conditions, and rigorous duty, requirements throughout the Middle East is an assurance for longer life cycle and high performance of cables.

Ducab's experienced Technical and R & D Staff provides guidance on cable selection and installation and to ensure the right cable for the application.



QUALITY MANAGEMENT SYSTEM CERTIFIED TO ISO 9001 AND NQA1

Ducab's Quality Management System conforms to the ISO 9001 International Quality System Standard and is certified by BASEC (British Approvals Service for Cables), a specialist certifying body for cables who are an internationally recognised quality authority accredited in the UK and throughout the world.

Certification to the ISO 9001 International standard demonstrates that Ducab has drawn up written procedures to ensure full compliance with all requirements of the standard and that these procedures are followed by every department in the company, thus ensuring that goods leaving Ducab's factory are of the highest quality and meet each customer's requirements in every respect.



Ducab is particularly proud to have achieved certification to the stringent ISO 9001

standard as it is an independent conformation that the company designs, manufactures and tests cables consistently to accepted standards.

Ducab Quality Management System is also compliant to Nuclear Quality Assurance standard NQA 1 which is applied to safety critical products to Nuclear Industry

ENVIRONMENTAL MANAGEMENT SYSTEM CERTIFIED TO ISO 14001

Ducab's Environmental Management System conforms to the ISO 14001 International Environmental Management Standard and is certified by BASEC who are an internationally recognised certifying authority accredited in the UK and throughout Europe.



Certification to the ISO 14001 International standard shows that Ducab has a well defined structure and established working practices aimed at limiting its impact on the environment. Measurement and monitoring of effects, issuing work instructions, training of personnel and taking corrective actions are all essential elements to limiting the impact on the environment. Ducab has set improvement targets to reduce the significant environmental impacts associated with its activities.

Ducab is proud to be the first cable manufacturer in the region to achieve certification to ISO 14001 and this certification along with its quality, business success and safety record demonstrates that Ducab is a world class organisation and can hold its head up to any business community throughout the world.

HEALTH & SAFETY MANAGEMENT SYSTEM CERTIFIED TO OHSAS 18001



Ducab is able to maintain a close watch on world developments in cable technology and regulations and therefore ensure that its products are designed and constructed to be hazard-free under the prescribed conditions of use.

Ducab uses only tried and tested materials and processes in full compliance with all relevant British and International Standards. Our cables are therefore manufactured for safe use without risk to health on the understanding that users will exercise the same degree of care in their selection and application.



Safety is an important issue for Ducab, and the stringent standards are adhered to throughout the company. Ducab is proud of its safety record and has been awarded RoSPA (Royal Society for the Prevention of Accidents) Gold Awards for safety since 1991. From 2000 onward, Ducab was awarded the prestigious President's Award for Health and Safety which is a recognition of Ducab winning 10 consecutive annual Gold awards and acknowledges Ducab's total commitment to health and safety. In 2002, Ducab was declared the joint winner of the Manufacturing Industry Sector Award from RoSPA.

DUCAB SHAREEK

Ducab's customer satisfaction programme is designed to ensure that customers receive a consistently high level of service from Ducab's dedicated staff.



APPROVAL CERTIFICATES



PRODUCT RANGE

Voltage range: 0.6/1kV and 1.9/3.3 kV

Cable Types

- 1) Armoured/unarmoured XLPE insulated cables
- 2) Lead sheathed cables
- 3) Copper or Aluminium PE tape (with drain wire) shielded

Cable sizes

- Single core up to and including 1000 mm²
- 2 core up to and including 300 mm²
- 3 core up to and including 400 mm²
- 4 core up to and including 500 mm²
- 5 core up to and including 95 mm²

Specification

BS 5467.....for XLPE insulated armoured cables

BS 7889.....for XLPE insulated single core unarmoured cables

IEC 60502 (Part 1).....for XLPE insulated single/multicore armoured/unarmoured cables

Any other International Specification as per VDE/DIN, GOST and as per customer's specifications.

SPECIFICATION AND CONSTRUCTION

CONDUCTORS

It is the current carrying component of the cable.

Material: Plain, stranded, compacted copper as per IEC: 60228

Aluminium, stranded, compacted conductors

INSULATION

The rated voltage level of the cable depends on the dielectric strength and thickness of the insulation.

Material: Cross-linked polyethylene (XLPE) Type GP8 as per BS 7655:Section 1.3.

Colour Masterbatch

Ultra-violet (UV) resistant polyethylene masterbatch is used for colouring of insulation. This protects the insulation from deterioration when exposed to continuous sunlight.

CORE IDENTIFICATION

Core identification is by colour as follows (unless otherwise agreed):

1 core					
2 core	Red	Black			
3 core					
	Red	Yellow	Blue		
4 core					
	Red	Yellow	Blue	Black	
5 core					
	Red	Yellow	Blue	Black	Green/Yellow

* Cables to new colour scheme of BS 5467 eg. Blue, Brown, Black, Grey could also be supplied on special request

FILLERS

For providing circular shape to the cable, non-hygroscopic compatible fillers (wherever necessary) are included between laid up cores.

Metallic Screen

If required by the customer screening may be provided for electrical shielding.

Material

Copper tape / Copper laminate / Aluminium laminate

Aluminium PE tape along with tinned copper drain wire (for providing screen continuity).

Note: Special constructions other than stated above may be provided on request.

Barrier Tape

Material

Polypropylene/PETP tape is used as a barrier tape over the laid up cores.

Functions

Holds the cores together and prevents them from opening out.

Works as a separator between different polymers used in a cable.

BEDDING

Extruded bedding serves as a bedding for the armour and as a protection for the laid-up cores.

Material

Extruded PVC Type 9 Compound as per BS 7655. Reduced propagation flame retardant (RPLHCL)/RP PVC Compound for reduced flame propagation characteristics.

Smokemaster Low smoke and Zero Hallogen for installations where fire hazards exist.

ARMOUR

Armour provides mechanical protection to the cable. It also serves as an Earth Continuity Conductor (ECC). One layer of round wire is applied helically over the bedding.

Material

Galvanised round steel wire (GSW).

Galvanised round steel wire (GSW) **along with tinned copper wires (TCW) for maintaining specified conductivity of armour (if required by the customer).**

Aluminium round wire armour (AWA) is generally used for single core ac circuits as aluminium is a non-magnetic material and this will reduce losses due to armour.

Note: Aluminium glands should be used in conjunction with cables having aluminium wire armour.

OVERSHEATH - FINISH

Following types of materials may be specified for oversheathing.

- **General Purpose:** Extruded PVC Type 9 Compound as per BS 7655.
- **Medium Density Polyethylene (MDPE):** Offers higher protection from water ingress and mechanical abrasion.
- **Anti Termite:** Termite resistance can be built in both types described above by compounding with proper additives.
- **Reduced Propagation (RP):** Retards propagation of flame in fire situation. (Oxygen Index \approx 30)
- **Reduced Propagation and Low Acid Fumes (RPLHCL):** Retards propagation of flames and gives low emission of hydrochloric acid fumes. (OI \approx 30 & acid gas emission is less than 18%)

SALIENT FEATURES OF DUCAB CABLE DESIGN

(1) XLPE insulation Ultra-violet (UV) colour masterbatch

Ultra-violet (UV) resistant polyethylene masterbatch is used for colouring of insulation. This protects the insulation from deterioration when exposed to continuous sunlight.

(2) Polypropylene/PETP tape over the laid up cores

Acts as a separator between different polymers used in a cable.

(3) Fillers

For ensuring proper circular shape to the cable, non-hygroscopic compatible fillers (wherever necessary) are included between laid up cores.

(4) Special requirements

Ducab cables can be custom designed to incorporate special requirements of the client as follows:

- (a) Screening: Copper tape or Aluminium PE tape (along with tinned copper drain wire) can be used for shielding purposes.
- (b) Tinned copper wire can be used along with galvanised round steel wires to maintain specified armour conductivity requirements.
- (c) Reduced propagating flame retardant bedding (RPLHCL/RP) and outersheath material can be offered to meet reduced flame propagation characteristics and low hydrogen acid gas emission.
- (d) Cable with bedding and outersheath material of special LSZH (Low Smoke and Zero Halogen) compound can be offered for installations where fire and its associated problems - the emission of smoke and toxic fumes - offer a serious potential threat. (For details on LSZH cables refer page 33-34)
- (e) In water logged areas or where the cables are required to be abrasion resistant, cable with medium density polyethylene (MDPE) can be offered.
- (f) For protection from insects, anti-termite protection can be added to the outersheath.

(5) Fire test requirement

Cables sheathed with general purpose PVC Type 9 meet fire test requirement of IEC 60332-1.

Cables with varying fire performance requirements are manufactured by Ducab. The details on this are provided on request.

INSTALLATION

Whichever form of conductor is used, XLPE insulated cables are simple to handle, install and joint. All the cables described in this publication can be used indoors or outdoors, but some reservations are necessary concerning cables for direct burial in the ground or for use in sustained wet conditions as follows:

- (i) Unarmoured cables are not generally recommended for laying directly in the ground.
- (ii) Cables laid directly in the ground, particularly in sustained wet conditions, should have extruded bedding and preferably MDPE - Medium Density Polyethylene - as the outersheath material.

Other important factors to be taken into account are:

Sheath Damage

Care should be taken to ensure that the oversheath is not damaged during installation. This is especially important where aluminium wire armour is used, as ingress of moisture could lead to corrosion or ultimate loss of earth continuity.

Minimum Installation Radius

Cable should not be bent during installation to a radius smaller than that recommended below. Wherever possible larger installation radii should be used.

Type of Cable	Overall Diameter (D)	Minimum internal radius of bend
Circular copper conductors armoured or unarmoured	Any	6D
Shaped copper or aluminium conductors, armoured or unarmoured	Any	8D
For lead sheathed cables	Any	12D

Connectors

The use of compression type connectors is recommended for XLPE insulated cables since the use of soldered connectors would limit the maximum short circuit temperature of the cable to 160°C (and consequently reduce the final short circuit current by approximately 30%).

Overhead terminations

Ultra violet resistant sleeving or taping should be provided on XLPE insulated cores to avoid degradation due to exposure to solar rays.

Armoured Single Core Cables for AC Operation

The current rating provided for single core cables is based on armour bonded / earthed at both ends. Armour bonding at both ends results in circulating current in the armour.

Higher current rating may be achieved in case the armour is bonded / earthed at single end. However single end bonding results in an induced voltage at the unearthed end of the armour. The magnitude of induced voltage is directly proportional to the current through the conductor and length of the cable. At times the magnitude of induced voltage could pose potential risk if no limiting device is connected at the open end. For this purpose sheath voltage limiters are in use.

Ducab strongly recommends use of an insulated adopter in the cable gland, while terminating single core cables for AC operation.

Single core cables for AC operation should not pass through steel conduit or steel gland plate, as it produces a heating effect.

CABLE SUPPORT SPACING

As per IEE Wiring Regulations where the cable is not continuously supported it shall be supported by suitable means at appropriate intervals in such a manner that the cable does not suffer damage by its own weight.

CURRENT RATINGS

Current ratings for XLPE insulated cables for 'ground' and 'duct' installation are derived from the latest issue of ERA Report 69-30 Part 5 which is based upon IEC Publication 60287. The ratings for 'In Air' installation are taken from IEE Wiring Regulations.

All the ratings given are for single circuits installed thermally independent of other circuits or any other heat source and on the basis of the standard conditions of installation given in relevant Tables. For other ambient or ground temperatures, depth of laying, soil thermal resistivity, the rating must be multiplied by relevant rating factors in Tables.

It should be noted that if XLPE insulated cables, are subjected to operating temperatures appreciably higher than the 90°C permissible for continuous operation, the insulation will undergo premature ageing thus affecting the normal life of the cable. However, limiting maximum conductor temperature to 105°C during overloads with duration not exceeding 4 hours on any one occasion, or a maximum of 100 hours in any 12 consecutive months, or a total of 500 hours in the cable's lifetime, would be tenable.

IEE WIRING REGULATIONS - REQUIREMENT FOR CABLES

The IEE Wiring Regulations for installation and selection of cables cannot be approached in isolation from the other equipment in the installation. In particular the devices providing protection against overload, short circuit, shock by indirect contact and over-heating of protective conductors during an earth fault, affect the selection of cables.

CROSS SECTIONAL AREAS OF PROTECTIVE CONDUCTORS (Clause 543 of the 16th Edition of IEE Wiring Regulations)

Regulation 543 explains how the cross sectional area of the circuit protective conductor should be calculated to avoid it over-heating during a fault to earth. Again the area required depends on the characteristics of the device providing protection against short circuit.

The steel wire armour of standard cables to BS 5467 (XLPE) and BS 6346 (PVC) provides the required area, or more, when the protective device is one of the standard fuses or MCB's with a rating not higher than the current rating of the cable (assuming disconnection within 5 seconds).

For the most of the cables the armour is still adequate when the fuse rating is one or two steps, or even more, above the current rating of the cable, the margins being greater for the small sizes and 4 core cables than for the larger sizes and two core cables.

VOLTAGE DROP

Voltage drop is normally only of importance for cables of voltage rating 600/1000V or below. If the installation is to be in compliance with Regulation 525 of the 16th Edition of the IEE Wiring Regulations, it is stipulated that "the voltage drop within the installation does not exceed a value appropriate to the safe functioning of the associated equipment in normal service. The requirement is deemed to be satisfied if the drop in voltage from the origin of the installation (usually supply terminals) and the fixed current using equipment does not exceed 4 per cent of the nominal voltage of the supply, disregarding starting conditions."

(Note: Diversity can be taken into account when calculating voltage drop).

Since the actual power factor of the load is often not known, the most practical approach to the question of voltage drop is to assume the worst conditions i.e. where the phase angle of the load is equal to that of the cable. The voltage drop values in the tables have been based on this assumption. For conductor sizes up to and including 120 mm² the figures provided apply with sufficient accuracy where the power factor lies between 0.6 lagging and 1.0, and for large cables where the power factor of the load does not exceed 0.8 lagging. Where the phase angles of the loads fall outside this range, the voltage drop deduced from the tables may be unduly conservative and more exact methods of calculation should be employed.

كابات الجهد المنخفض XLPE Insulated Low Voltage Cables

The values of voltage drop for 600/1000 V rated cables are given in the current rating tables.

In those cases where the actual current differs greatly from the tabulated current rating, the results obtained from the tables are only approximate; for a more accurate assessment, allowance should be made for the change in conductor resistance with operating temperature. It should also be ensured that the cable size ultimately selected is capable of carrying the required current under the site conditions of installation.

Values of voltage drop are tabulated for a current of one ampere for a 1 metre run, i.e. for a distance of 1 metre along the route taken by the cables, and represent the effect of the voltage drop in all the circuit conductors. For balanced three phase ac circuits, the values relate to the line voltage. For any given run the values need to be multiplied by the length of the run (in metres) and by the current (in amperes) that the cables are to carry.

Examples: Consider a route of 200 metres of 4 Core armoured cable to be installed in air and to carry 100 amperes load per phase, with the supply voltage being 415 volts, three phase 50 Hz and the cable to be Copper XLPE/SWA/ PVC.

Using the Tables:

Let V_d be the voltage drop in volts.

where I = Current in amperes L = Route length in metres mV = Approximate volt drop/ampere/metre

Assume maximum permissible volt drop = 4 per cent of 415 volts = 16.6 volts

Substitute for current, route length and maximum permissible volt drop

$$\text{then } V_d = \frac{mV \times I \times L}{1000} \quad \text{or} \quad mV = \frac{V_d \times 1000}{I \times L}$$

$$mV = \frac{16.6 \times 1000}{200 \times 100} = 0.83$$

Select a cable from the relevant Current Rating Table 26 such that the “mV value” from the voltage drop column is equal to or less than the 0.83 mV calculated, ensuring that it will carry the current. It will be seen that this value is 0.6 giving a cable size of 70mm². However, 100 Amp load could be less than 80% current carrying capacity of 50mm² cable, in which case of 50 mm² cable will suffice.

RATING FACTORS

Where the conditions of installation differ from those defined in the current rating tables, the following rating factors may be used for cables size selection. (Reference ERA report)

CABLES LAID DIRECTLY IN GROUND

Ratings for cables installed directly in the ground are based on values of soil temperature and soil thermal resistivity which are generally representative of conditions in the United Kingdom. Rating factors to take account of variation in ground temperatures are given in Table 2. Where conditions of operation can be fairly accurately estimated and knowledge of the soil along the route is available, it is possible to determine the ratings more precisely by the use of the soil thermal resistivity factors, grouping factors, and factors for the depths of laying given in Tables 3 to 6.

RATING FACTORS FOR GROUND TEMPERATURE

Ground temperature	15°C	20°C	25°C	30°C	35°C	40°C	45°C
Cable Type	Rating factor						
XLPE Insulated	1.0	0.97	0.93	0.89	0.86	0.82	0.76


RATING FACTORS FOR VARIATION IN THERMAL RESISTIVITY OF SOIL (AVERAGE VALUES)

Size of cables mm ²	Soil thermal resistivity in °C m/W						
	0.8	0.9	1.0	1.5	2.0	2.5	3.0
Single core cables							
Up to 150	1.16	1.12	1.07	0.91	0.81	0.73	0.66
From 185 to 300	1.17	1.12	1.07	0.91	0.80	0.73	0.66
From 400 to 1000	1.17	1.12	1.07	0.91	0.80	0.73	0.66
Multicore cables							
Up to 16	1.12	1.08	1.05	0.93	0.84	0.77	0.72
From 25 to 150	1.14	1.10	1.06	0.92	0.82	0.75	0.69
From 185 to 500	1.15	1.10	1.07	0.92	0.81	0.74	0.67

RATING FACTORS FOR DEPTH OF LAYING (TO CENTRE OF CABLE OR TREFOIL GROUP OF CABLES)

Depth of laying m	600/1000 Volt			1900/3300 Volt	
	Up to 50mm ²	70mm ² to 300mm ²	Above 300mm ²	Up to 300mm ²	Above 300mm ²
0.50	1.00	1.00	1.00	-	-
0.60	0.99	0.98	0.97	-	-
0.80	0.97	0.96	0.94	1.00	1.00
1.00	0.95	0.93	0.92	0.98	0.97
1.25	0.94	0.92	0.89	0.96	0.95
1.50	0.93	0.90	0.87	0.95	0.93
1.75	0.92	0.89	0.86	0.94	0.91
2.00	0.91	0.88	0.85	0.92	0.89
2.50	0.90	0.87	0.84	0.91	0.88
3.00 or more	0.89	0.85	0.82	0.90	0.86


GROUP RATING FACTORS FOR CIRCUITS OF THREE SINGLE CORE CABLES IN TREFOIL OR LAID FLAT TOUCHING, IN HORIZONTAL FORMATION

Number of Circuits			Spacing of Circuits				
	Touching**						
	Trefoil	Laid flat	0.15 m*	0.30 m	0.45 m	0.60 m	
	600/1000 Volt cables	2	0.78	0.81	0.83	0.88	0.91
3		0.66	0.70	0.73	0.79	0.84	0.87
4		0.61	0.64	0.68	0.73	0.81	0.85
5		0.56	0.60	0.64	0.73	0.79	0.85
6		0.53	0.57	0.61	0.71	0.78	0.82
1900/3300 Volt cables	2	0.78	0.80	0.82	0.86	0.89	0.91
	3	0.66	0.68	0.71	0.77	0.80	0.83
	4	0.59	0.62	0.65	0.72	0.77	0.80
	5	0.55	0.58	0.61	0.68	0.74	0.78
	6	0.52	0.55	0.58	0.66	0.72	0.76

* This spacing will not be possible for some of the larger diameter cables.

** For high current carrying cables (i.e. large size) it is advisable to allow spacing between circuits. Alternatively the most appropriate group rating factor must be applied when determining the cable size and required number of cables in parallel.

GROUP RATING FACTORS FOR MULTICORE CABLES IN HORIZONTAL FORMATION

Number of Cables in Group						
		Spacing				
		Touching**	0.15 m*	0.30 m	0.45 m	0.60 m
600/1000 Volt cables	2	0.81	0.87	0.91	0.93	0.95
	3	0.70	0.78	0.84	0.88	0.90
	4	0.63	0.74	0.81	0.86	0.89
	5	0.59	0.70	0.78	0.84	0.87
	6	0.55	0.68	0.77	0.83	0.87
1900/3300 Volt cables	2	0.80	0.85	0.89	0.91	0.93
	3	0.68	0.76	0.81	0.84	0.87
	4	0.62	0.71	0.77	0.81	0.84
	5	0.57	0.66	0.73	0.78	0.82
	6	0.54	0.64	0.71	0.77	0.81

* For high current carrying cables (i.e. large size) it is advisable to allow spacing between circuits. Alternatively the most appropriate group rating factor must be applied when determining the cable size and required number of cables in parallel.

CABLES INSTALLED IN DUCTS

The term ducts applies to single way earthenware, fibre or ferrous pipes.

RECOMMENDED DUCT DIMENSIONS AND CABLE SIZES

Overall cable diameter mm	Duct	
	Inside diameter mm	Outside diameter mm
Up to and including 65	100	130
Above 65 up to and including 90	125	160

Ratings for cables installed in single way ducts, underground, have been based on values of soil temperature and soil thermal resistivity which are generally representative of conditions in the United Kingdom. Rating factors to take account of variations in ground temperatures are given in Table 2. Where conditions of operation can be fairly accurately estimated, and knowledge of the soil along the route is available, it is possible to determine the ratings more precisely by the use of estimated maximum ground temperature, the soil thermal resistivity factors, grouping factors, and factors for the depths of laying given.

RATING FACTORS FOR GROUND TEMPERATURE

Note: Same as for direct in ground.


RATING FACTORS OF VARIATION IN THERMAL RESISTIVITY OF SOIL (AVERAGE VALUES)

Size of cable mm ²	Soil thermal resistivity in °C m/W						
	0.8	0.9	1.0	1.5	2.0	2.5	3.0
Single Core Cable							
Up to 150	1.10	1.07	1.04	0.94	0.86	0.80	0.76
From 185 to 300	1.11	1.08	1.05	0.93	0.85	0.79	0.75
From 400 to 1000	1.12	1.08	1.05	0.93	0.84	0.78	0.74
Multicore Cables							
Up to 16	1.04	1.03	1.02	0.97	0.92	0.88	0.86
From 25 to 150	1.06	1.04	1.03	0.95	0.90	0.85	0.81
From 185 to 500	1.07	1.05	1.03	0.95	0.88	0.83	0.78

RATING FACTORS OF DEPTH OF LAYING (TO CENTRE OF DUCT OR TREFOIL GROUP OF DUCTS)


Depth in laying m	600/1000 Volt		1900/3300 Volt	
	Single Core	Multicore	Single Core	Multicore
0.50	1.00	1.00	-	-
0.60	0.98	0.99	-	-
0.80	0.95	0.98	1.00	1.00
1.00	0.93	0.96	0.98	0.99
1.25	0.91	0.95	0.95	0.97
1.50	0.89	0.94	0.93	0.96
1.75	0.88	0.94	0.92	0.95
2.00	0.87	0.93	0.90	0.94
2.50	0.86	0.92	0.89	0.93
3.00 or more	0.85	0.91	0.88	0.92

GROUP RATING FACTORS FOR SINGLE CORE CABLES IN TREFOIL SINGLE WAY DUCTS, HORIZONTAL FORMATION (AVERAGE VALUES)

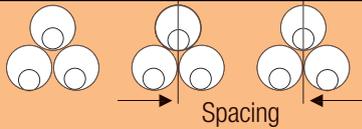Number of Circuits				
	Spacing			
	Touching*	0.45 m	0.60 m	
600/1000 Volt Cables	2	0.87	0.91	0.93
	3	0.78	0.84	0.87
	4	0.74	0.81	0.85
	5	0.70	0.79	0.83
	6	0.69	0.78	0.82
1900/3300 Volt Cables	2	0.85	0.88	0.90
	3	0.75	0.80	0.83
	4	0.70	0.77	0.80
	5	0.67	0.74	0.78
6	0.64	0.72	0.76	

* For high current carrying cables (i.e. large size) it is advisable to allow spacing between circuits. Alternatively the most appropriate group rating factor must be applied when determining the cable size and required number of cables in parallel.

GROUP RATING FACTORS FOR MULTICORE CABLES IN SINGLE WAY DUCTS, HORIZONTAL FORMATION (AVERAGE VALUES)

Number of Circuits					
		Spacing			
		Touching*	0.30 m	0.45 m	0.60 m
600/1000 Volt Cables	2	0.90	0.93	0.95	0.96
	3	0.83	0.88	0.91	0.93
	4	0.79	0.85	0.89	0.92
	5	0.75	0.83	0.88	0.91
	6	0.73	0.82	0.87	0.90
1900/3300 Volt Cables	2	0.88	0.91	0.93	0.94
	3	0.80	0.85	0.88	0.90
	4	0.76	0.81	0.85	0.88
	5	0.72	0.78	0.83	0.86
	6	0.69	0.76	0.81	0.85

* For high current carrying cables (i.e. large size) it is advisable to allow spacing between circuits. Alternatively the most appropriate group rating factor must be applied when determining the cable size and required number of cables in parallel.

CABLES INSTALLED IN AIR

It is anticipated that many of the “in air” installations will be in buildings, and the ratings are therefore given in accordance with IEE Wiring Regulations for Electrical Installations, 16th Edition.

It should be noted that all ratings for cables run in free air have been based on the assumption that they are shielded from the direct rays of the sun without restriction of ventilation. The rating for cables subjected to direct sunlight should be reduced to take account of this factor and further guidance on this subject is available on request.

RATING FACTORS FOR OTHER AMBIENT AIR TEMPERATURES

Air Temperature	25°C	30°C	35°C	40°C	45°C	50°C	55°C
XLPE Insulated	1.02	1.0	0.96	0.91	0.87	0.82	0.76

DEFINED CONDITIONS OF INSTALLATION

The ‘in-air’ current ratings given in relevant Tables between 18 to 34 are based on the installation conditions in air as follows:

(a) Single core cables

- (1) Two single core cables are installed one above the other, fixed to the vertical surface of a wall or open cable trench, the distance between the wall and the surface of the cable being not less than 20mm.

Cables are installed at a distance between centres of twice the overall diameter of the cable, i.e. 2D, where D = overall diameter of cable.

- (2) Three single core cables are installed in trefoil formation, fixed to the vertical surface of a wall or open cable trench, the cables touching throughout and the distance between the wall and the surface of the nearest cable being not less than 20mm. The cables are assumed

كابلات الجهد المنخفض XLPE Insulated Low Voltage Cables

to be remote from iron, steel or ferro-concrete, other than the cable supports. Single core armoured cables to be electrically bonded at each end of the run.

(b) Multicore Cables

Cables of all types other than single core cables are installed singly, fixed to the vertical surface of a wall or open cable trench, the distance between the surface of the cable and the wall being not less than 20 mm in every instance.

If it is necessary for cables to be installed at distances less than those described above, then the values tabulated under the heading "Clipped direct to a surface..." in the IEE Wiring Regulations should be employed.

SHORT CIRCUIT RATINGS – CONDUCTORS


Conductor size mm ²	Short circuit ratings for 1 second in KA	
	Copper Conductor	Aluminium Conductor
1.5	0.21	0.14
2.5	0.36	0.24
4	0.57	0.38
6	0.86	0.56
10	1.43	0.94
16	2.29	1.50
25	3.58	2.35
35	5.00	3.29
50	7.15	4.70
70	10.01	6.58
95	13.59	8.93
120	17.16	11.28
150	21.45	14.10
185	26.46	17.39
240	34.32	22.56
300	42.90	28.20
400	57.20	37.60
630	90.09	59.22
800	114.40	75.20
1000	143.00	94.00

Note: For any other duration 't' seconds divide the given value by \sqrt{t}


The values of fault current given in the graph are based on the cable being fully loaded at the start of the short circuit (conductor temperature 90°C) and a final conductor temperature of 250 °C. It should be ensured that the accessories associated with the cables are also capable of operation at these values of fault current and temperature.

Note: With XLPE cables the use of soldered type connectors (instead of the compression type) is not recommended since their use in the system would limit the final conductor temperature to 160 °C (and consequently reduce the fault current rating by approximately 30 per cent).

Copper Conductors

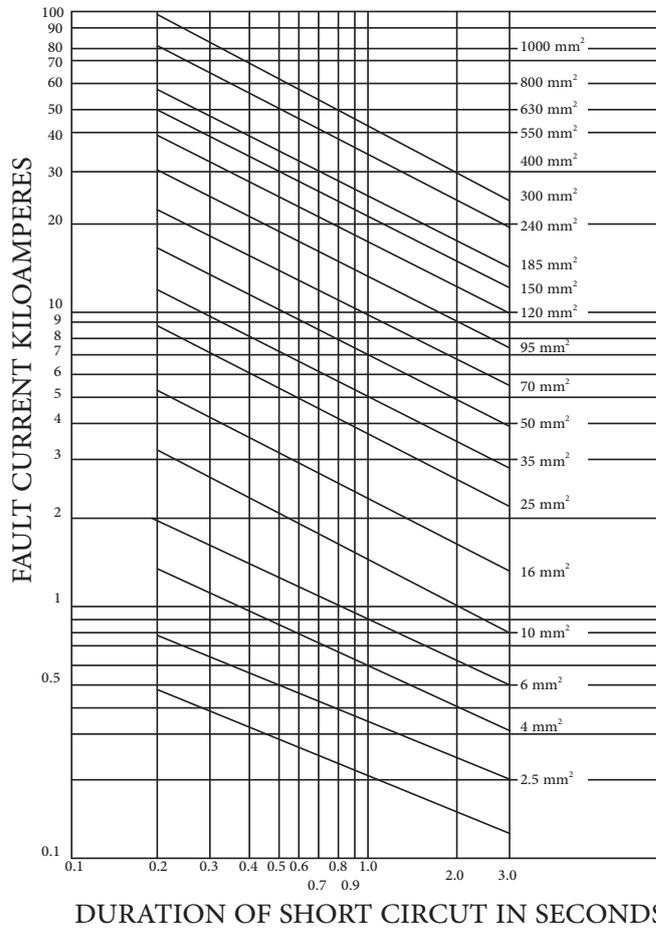

Aluminium Conductors

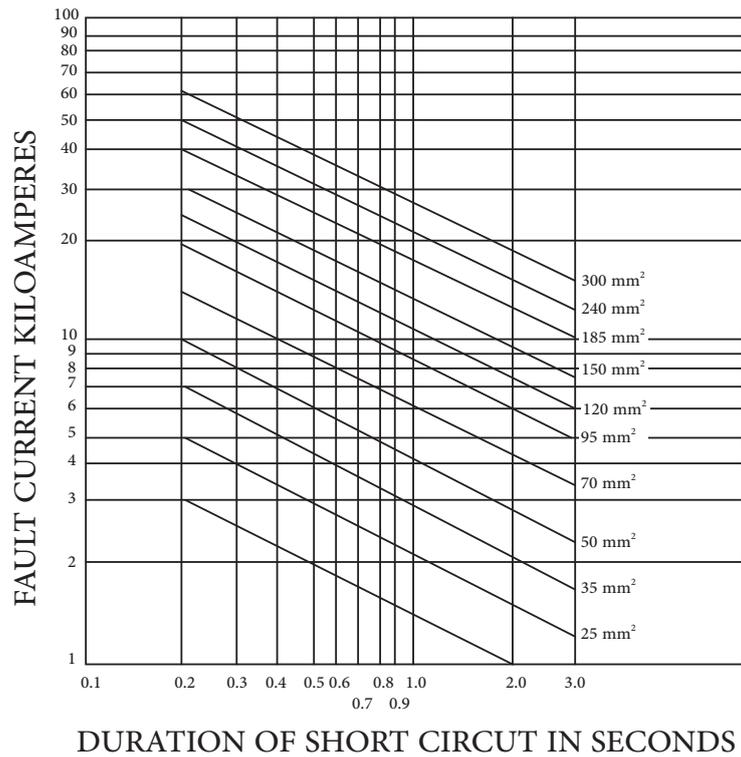

SHORT CIRCUIT RATINGS – ARMOUR

XLPE INSULATED CABLES

ARMOUR FAULT CURRENTS TO EARTH (FOR A FAULT DURATION OF 1 SECOND)

Nominal Area of Conductor mm ²	Aluminium Wire Armour		Steel Wire Armour				
	600/1000 V	1900/3300 V	600/1000 V				1900/3300 V
	Single Core amp	Single Core amp	Two Core amp	Three Core amp	Four Core amp	Four Core (reduced neutral) amp	Three Core amp
	XLPE	XLPE	XLPE	XLPE	XLPE	XLPE	XLPE
16	-	-	1800	2000	2200	-	3700
25	-	-	1900	2800	3200	3200	4200
35	-	-	2800	3200	3600	3400	4700
50	4000*	4700*	3100	3500	4100	3900	5600
70	4700*	5200*	3600	4100	6000	5900	6200
95	5200*	5700*	5100	5800	6700	6600	6900
120	5700*	6100	-	6400	9400	7500	9400
150	6400	6400	-	9200	10500	10000	10100
185	7100	7100	-	10100	11700	11500	10800
240	7900	7800	-	11500	13200	12800	11900
300	8800	8500	-	12300	14600	13900	13000
400	12400	12000	-	-	20700	20700	-
500	13800	13300	-	-	22500	22500	-
630	15400	14900	-	-	-	-	-
800	21300	-	-	-	-	-	-
1000	23400	-	-	-	-	-	-

* Based on wire diameters larger than those specified in BS 5467.

- Notes:**
1. The ratings given in the Table above are based on a fault duration of one second and an armour temperature rise from 80°C at commencement of the fault to a final temperature of 200°C.
 2. The asymmetrical fault rating of the smaller sizes may be decided by the short circuit capability of the conductor rather than the armour rating. It is therefore necessary to compare the two ratings.

CONDUCTOR / ARMOUR RESISTANCE AND REACTANCE VALUES

600/1000 V SINGLE AND MULTICORE CABLES HAVING WIRE ARMOUR


Nominal Area of Conductor mm ²	Maximum resistance of Cable - Armour in ohms/km at 20°C											Inductive reactance (approx) per core of 3 phase circuit in ohm/km @ 50 Hz		
	Copper Conductor	Aluminium Conductor	Single Core		Two core		Three Core		Four Core** (equal neutral)	Four Core (reduced neutral)	Single core cable	Two core cable	Three & Four core cable	
			With stranded copper conductor 600/1000 V	With stranded aluminium conductor 600/1000 V	600/ 1000 V	600/ 1000 V	1900/ 3300 V	600/ 1000 V						600/ 1000 V
	Aluminium wire armour		With stranded copper conductor & Galvanised Steel Wire Armour											
16	1.15	1.910	-	-	3.70	3.50	1.90	3.10	-	-	0.081	0.081	0.081	
25	0.727	1.200	-	-	3.70	2.50	1.70	2.30	2.30	-	0.079	0.079	0.079	
35	0.524	0.868	-	-	2.60	2.30	1.80	2.00	2.10	-	0.077	0.077	0.077	
50	0.387	0.641	1.30	0.75	2.30	2.00	1.30	1.80	1.90	0.106	0.076	0.076	0.076	
70	0.268	0.443	0.75	0.67	2.00	1.80	1.20	1.20	1.30	0.103	0.075	0.075	0.075	
95	0.193	0.320	0.67	0.61	1.40	1.30	1.10	1.10	1.10	0.098	0.073	0.073	0.073	
120	0.153	0.253	0.61	0.42	1.30	1.20	0.76	0.76	0.96	0.096	0.072	0.072	0.072	
150	0.124	0.206	0.42	0.39	1.20	0.78	0.71	0.68	0.71	0.097	0.073	0.073	0.073	
185	0.0991	0.164	0.38	0.37	0.82	0.71	0.65	0.61	0.63	0.096	0.073	0.073	0.073	
240	0.0754	0.125	0.34	0.34	0.73	0.63	0.59	0.54	0.56	0.092	0.072	0.072	0.072	
300	0.0601	0.100	0.31	0.31	0.67	0.58	0.55	0.49	0.52	0.09	0.072	0.072	0.072	
400	0.0470	0.0778	0.22	0.22	0.59	0.52	0.50	0.35	0.46	0.09	0.072	0.072	0.07	
500	0.0366	0.0605	0.20	0.20	-	-	-	-	-	0.089	-	-	-	
630	0.0283	0.0469	0.18	0.18	-	-	-	-	-	0.086	-	-	-	
800	0.0221	0.0367	0.13	0.13	-	-	-	-	-	0.083	-	-	-	
1000	0.0176	0.0291	0.12	0.12	-	-	-	-	-	0.08	-	-	-	

* The values given are for plain annealed copper conductors. For tinned conductors reference should be made to BS 6360.

** Multicore cables with stranded Aluminium conductor have same Armour resistances as those with Copper conductors.

XLPE INSULATED CABLES TO BS 5467 & IEC - 60502-1

DIMENSIONS AND WEIGHTS

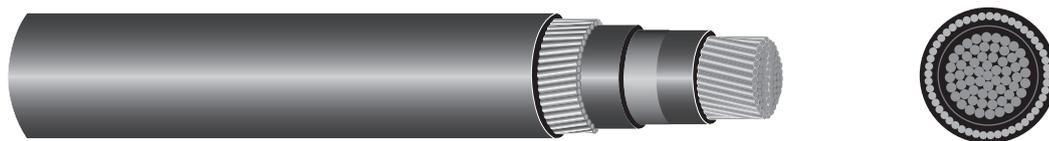

STRANDED COPPER & ALUMINIUM CONDUCTORS – SINGLE CORE CABLES

600/1000 V *UNARMoured AND ARMoured, PVC SHEATHED CABLES

Nominal area of conductor mm ²	Thickness of insulation	Unarmoured Cables (approximate values)			Armoured Cables (approximate values)				
		Cable diameter overall mm	Cable weight Aluminium kg/km	Cable weight Copper kg/km	Diameter under armour mm	Armour** wire diameter mm	Cable diameter overall mm	Cable weight Aluminium kg/km	Cable weight Copper kg/km
50	1.0	14.2	250	540	12.6	1.6***	18.4	460	800
70	1.1	16.2	330	760	14.5	1.6***	20.2	560	990
95	1.1	18.3	430	1020	16.4	1.6***	22.3	690	1280
120	1.2	20.2	510	1270	18.0	1.6***	24.2	800	1550
150	1.4	22.4	630	1560	19.8	1.6	27.4	970	1900
185	1.6	24.7	760	1930	22.0	1.6	30.0	1150	2320
240	1.7	27.7	970	2510	24.6	1.6	32.8	1380	2930
300	1.8	30.6	1190	3120	27.3	1.6	35.6	1640	3580
400	2.0	34.2	1500	3970	31.2	2.0	40.5	2130	4600
500	2.2	38.0	1900	4980	36.0	2.0	44.2	2610	5680
630	2.4	42.9	2420	6400	40.0	2.0	48.8	3180	7160
800	2.6	47.8	3120	8210	45.8	2.5	55.4	4230	9315
1000	2.8	53.0	3780	10275	50.8	2.5	60.6	5000	11490

* Single core unarmoured cables are as per BS 7889.

** Aluminium wire armour for AC system.

*** Wire diameters are larger than those specified in BS 5467.

Note: Cables with Stranded Aluminium Conductors conform to IEC 60502 - 1



CURRENT RATINGS (AC)

STRANDED COPPER & ALUMINIUM CONDUCTORS – SINGLE CORE CABLES

600/1000 V ARMOURED PVC SHEATHED CABLES

Nominal area of conductor mm ²	Stranded Copper Conductors						Stranded Aluminium Conductors					
	Current Ratings			Approximate voltage drop per ampere per metre			Current Ratings			Approximate voltage drop per ampere per metre		
	Direct in ground amps	In single way ducts amps	3D Installed in air amps	Ground mV	Duct mV	Air mV	Direct in ground amps	In single way ducts amps	3D Installed in air amps	Ground mV	Duct mV	Air mV
50	235	235	222	0.87	0.93	0.87	175	180	162	1.40	1.60	1.40
70	290	280	285	0.62	0.70	0.62	220	220	207	0.98	1.00	0.98
95	345	330	346	0.47	0.56	0.47	260	260	252	0.72	0.79	0.74
120	390	370	402	0.39	0.48	0.39	295	295	292	0.58	0.66	0.60
150	435	405	463	0.33	0.43	0.33	330	330	337	0.48	0.57	0.49
185	490	440	529	0.28	0.39	0.28	375	365	391	0.39	0.49	0.41
240	560	500	625	0.24	0.35	0.24	435	410	465	0.31	0.42	0.34
300	630	550	720	0.21	0.32	0.21	490	455	540	0.27	0.38	0.29
400	700	580	815	0.20	0.30	0.20	540	480	625	0.35	0.38	0.25
500	770	620	918	0.18	0.28	0.18	580	510	714	0.31	0.35	0.22
630	840	670	1027	0.17	0.26	0.17	630	540	801	0.28	0.32	0.20
800	888	692	1119	0.17	0.25	0.17	-	-	-	-	-	-
1000	942	735	1214	0.16	0.24	0.16	-	-	-	-	-	-

600/1000 V UNARMOURED PVC SHEATHED CABLES

Nominal area of conductor mm ²	Stranded Copper Conductors						Stranded Aluminium Conductors					
	Current Ratings			Approximate voltage drop per ampere per metre			Current Ratings			Approximate voltage drop per ampere per metre		
	Direct in ground amps	In single way ducts amps	 Installed in air amps	Ground mV	Duct mV	Air mV	Direct in ground amps	In single way ducts amps	 Installed in air amps	Ground mV	Duct mV	Air mV
50	230	240	209	0.85	0.93	0.87	175	180	159	1.40	1.50	1.45
70	285	295	270	0.61	0.70	0.61	215	220	206	0.98	1.10	0.98
95	335	345	330	0.45	0.56	0.45	255	260	253	0.71	0.79	0.73
120	385	395	385	0.36	0.48	0.37	295	300	296	0.57	0.66	0.59
150	435	445	445	0.31	0.43	0.31	325	335	343	0.47	0.57	0.47
185	490	500	511	0.26	0.39	0.26	370	375	395	0.39	0.49	0.39
240	570	580	606	0.22	0.35	0.22	430	440	471	0.31	0.42	0.32
300	650	650	701	0.19	0.32	0.20	490	510	544	0.26	0.38	0.27
400	740	750	820	0.17	0.30	0.18	550	570	638	0.36	0.38	0.23
500	840	850	936	0.16	0.28	0.16	620	640	743	0.33	0.35	0.20
630	960	960	1069	0.15	0.26	0.15	690	730	849	0.28	0.32	0.19
800	1120	1130	1214	0.15	0.25	0.15	-	-	-	-	-	-
1000	1300	1320	1349	0.14	0.24	0.14	-	-	-	-	-	-

Direct in ground - Trefoil touching
 Single way ducts - ducts touching
 Spacing in air - As shown above (D = Cable diameter)
 Non magnetic wire armour bonded at both ends

Installation conditions for above ratings: Ambient air temperature: 30°C
 Depth of laying: 0.5 m
 Soil thermal resistivity: 1.2°C m/W
 Maximum conductor operating temperature at rated current is 90°C
 For rating factors see Tables 2 to 6 and 8 to 12

XLPE INSULATED CABLES TO BS 5467 & IEC - 60502 - 1

DIMENSIONS AND WEIGHTS



STRANDED COPPER & ALUMINIUM CONDUCTORS TWO CORE CABLES

600/1000 V *UNARMoured AND ARMoured, PVC SHEATHED CABLES

Nominal area of conductor mm ²	Thickness of insulation mm	Unarmoured Cables (approximate values)			Armoured Cables (approximate values)				
		Cable diameter overall mm	Cable weight Aluminium kg/km	Cable weight Copper kg/km	Diameter under armour mm	Armour** wire diameter mm	Cable diameter overall mm	Cable weight Aluminium kg/km	Cable weight Copper kg/km
16*	0.7	17.0	-	475	15.2	1.25	20.4	-	900
25*	0.9	20.2	415	740	18.5	1.25	24.1	915	1240
35*	0.9	22.5	480	955	21.5	1.60	27.7	1255	1710
50	1.0	20.4	497	1100	18.7	1.60	25.8	1430	1800
70	1.1	23.1	690	1520	21.5	1.60	29.0	1780	2320
95	1.1	26.5	850	2050	24.6	2.00	33.1	1950	3150
120	1.2	28.4	1170	2610	26.8	2.00	36.1	2440	3880
150	1.4	31.7	1450	3220	29.7	2.00	39.3	3050	4820
185	1.6	35.1	1810	4030	33.3	2.50	44.7	3690	5920
240	1.7	40.3	2280	5200	38.1	2.50	49.0	4380	7300
300	1.8	44.3	2760	6430	42.3	2.50	53.5	5100	8770

* Circular conductor, all others are sector shaped.

Note: Unarmoured cables & cables with Stranded Aluminium Conductors conform to IEC 60502 - 1

CURRENT RATINGS (AC)

STRANDED COPPER & ALUMINIUM CONDUCTORS – TWO CORE CABLES

600/1000 V ARMoured PVC SHEATHED CABLES

Nominal area of conductor mm ²	Stranded Copper Conductors						Aluminium Conductors					
	Current Ratings			Approximate voltage drop per ampere per metre			Current Ratings			Approximate voltage drop per ampere per metre		
	Direct in ground amps	In single way ducts amps	Installed in air amps	Ground mV	Duct mV	Air mV	Direct in ground amps	In single way ducts amps	Installed in air amps	Ground mV	Duct mV	Air mV
16*	140	115	115	2.9	2.9	2.9	-	-	-	-	-	-
25*	180	145	152	1.9	1.9	1.9	135	110	112	3.1	3.1	3.1
35*	215	175	188	1.3	1.3	1.3	165	130	138	2.2	2.2	2.2
50	255	210	228	1.0	1.0	1.0	195	155	166	1.7	1.7	1.7
70	315	260	291	0.7	0.7	0.7	240	195	211	1.1	1.1	1.1
95	381	313	354	0.5	0.5	0.5	288	237	254	0.8	0.8	0.8
120	410	344	430	0.4	0.4	0.4	-	-	-	-	-	-
150	472	384	480	0.4	0.4	0.4	-	-	-	-	-	-
185	539	432	540	0.3	0.3	0.3	-	-	-	-	-	-
240	632	504	636	0.2	0.2	0.2	-	-	-	-	-	-
300	708	560	732	0.2	0.2	0.2	-	-	-	-	-	-
800	888	692	1119	0.17	0.25	0.17	-	-	-	-	-	-
1000	942	735	1214	0.16	0.24	0.16	-	-	-	-	-	-

* Circular conductor, all others are sector shaped

600/1000 V UNARMoured PVC SHEATHED CABLES

Nominal area of conductor mm ²	Stranded Copper Conductors						Aluminium Conductors					
	Current Ratings			Approximate voltage drop per ampere per metre			Current Ratings			Approximate voltage drop per ampere per metre		
	Direct in ground amps	In single way ducts amps	Installed in air amps	Ground mV	Duct mV	Air mV	Direct in ground amps	In single way ducts amps	Installed in air amps	Ground mV	Duct mV	Air mV
16*	140	115	115	2.9	2.9	2.9	-	-	-	-	-	-
25*	180	140	149	1.9	1.9	1.9	135	105	108	3.1	3.1	3.1
35*	215	170	185	1.3	1.3	1.3	165	130	135	2.2	2.2	2.2
50	255	205	225	1.0	1.0	1.0	195	150	164	1.7	1.7	1.7
70	315	255	289	0.7	0.7	0.7	240	195	211	1.2	1.2	1.2
95	380	311	352	0.5	0.5	0.5	285	235	257	0.8	0.8	0.8
120	410	344	430	0.4	0.4	0.4	-	-	-	-	-	-
150	473	384	480	0.4	0.4	0.4	-	-	-	-	-	-
185	542	432	540	0.3	0.3	0.3	-	-	-	-	-	-
240	641	504	650	0.2	0.2	0.2	-	-	-	-	-	-
300	741	560	750	0.2	0.2	0.2	-	-	-	-	-	-

Direct in ground - Cables touching Single way ducts - ducts touching

* Circular conductors, all others are sector shaped

Note: (1) 50mm² and above are with D-shaped conductor

(2) Unarmoured cables are as per IEC 60502 - 1

Installation conditions for above ratings:

Ambient air temperature: 30°C

Ground temperature: 15°C, Depth of laying: 0.5 m

Soil thermal resistivity: 1.2°C m/W

Maximum conductor operating temperature at rated current is 90°C

For rating factors see Tables 2 to 6 and 8 to 12

XLPE INSULATED CABLES TO BS 5467 & IEC - 60502 - 1

DIMENSIONS AND WEIGHTS



STRANDED COPPER & ALUMINIUM CONDUCTORS THREE CORE CABLES

600/1000 V *UNARMoured AND ARMoured, PVC SHEATHED CABLES

Nominal area of conductor mm ²	Thickness of insulation mm	Unarmoured Cables (approximate values)			Armoured Cables (approximate values)				
		Cable diameter overall mm	Cable weight Aluminium kg/km	Cable weight Copper kg/km	Diameter under armour mm	Armour** wire diameter mm	Cable diameter overall mm	Cable weight Aluminium kg/km	Cable weight Copper kg/km
16*	0.7	18.0	-	675	16.0	1.25	21.6	-	1130
25*	0.9	21.5	500	990	20.0	1.6	26.7	1220	1710
35*	0.9	24.0	610	1295	22.7	1.6	29.4	1415	2100
25	0.9	19.9	440	900	18.1	1.6	23.8	1040	1530
35	0.9	21.6	540	1190	19.8	1.6	25.7	1210	1870
50	1.0	24.6	740	1640	23.0	1.6	28.5	1550	2450
70	1.1	28.0	1050	2220	26.0	1.6	32.2	1810	3120
95	1.1	31.0	1170	2980	30.0	2.0	37.0	2500	4310
120	1.2	34.8	1440	3730	32.8	2.0	40.4	2870	5160
150	1.4	38.5	2300	5195	36.8	2.5	45.5	3660	7160
185	1.6	44.0	2750	6470	41.5	2.5	49.8	4320	8600
240	1.7	49.5	3020	8380	46.0	2.5	55.1	5170	10755
300	1.8	53.5	3660	10420	51.5	2.5	60.2	6100	13080
400	2.0	59.2	3730	11575	56.4	2.5	66.6	7050	15810

* Circular conductors, all others are sector shaped.

Note: Unarmoured cables & cables with Stranded Aluminium Conductors conform to IEC 60502 - 1

CURRENT RATINGS (AC)

STRANDED COPPER & ALUMINIUM CONDUCTORS – THREE CORE CABLES

600/1000 V ARMOURED PVC SHEATHED CABLES

Nominal area of conductor mm ²	Stranded Copper Conductors						Aluminium Conductors					
	Current Ratings			Approximate voltage drop per ampere per metre			Current Ratings			Approximate voltage drop per ampere per metre		
	Direct in ground amps	In single way ducts amps	Installed in air amps	Ground mV	Duct mV	Air mV	Direct in ground amps	In single way ducts amps	Installed in air amps	Ground mV	Duct mV	Air mV
16	115	94	99	2.5	2.5	2.5	89	72	74	4.2	4.2	4.2
25	150	125	131	1.7	1.7	1.7	115	94	98	2.7	2.7	2.7
35	180	150	162	1.2	1.2	1.2	135	110	120	1.9	1.9	1.9
50	215	175	197	0.9	0.9	0.9	165	135	145	1.4	1.4	1.4
70	265	215	251	0.6	0.6	0.6	200	165	185	1.0	1.0	1.0
95	315	260	304	0.5	0.5	0.5	240	200	224	0.7	0.7	0.7
120	360	300	353	0.4	0.4	0.4	275	230	264	0.6	0.6	0.6
150	405	335	406	0.3	0.3	0.3	310	255	305	0.5	0.5	0.5
185	460	380	463	0.3	0.3	0.3	350	295	350	0.4	0.4	0.4
240	530	440	546	0.2	0.2	0.2	410	340	418	0.3	0.3	0.3
300	590	495	628	0.2	0.2	0.2	460	385	488	0.3	0.3	0.3
400	667	570	728	0.2	0.2	0.2	520	443	562	0.2	0.2	0.2

600/1000 V UNARMOURED PVC SHEATHED CABLES

Nominal area of conductor mm ²	Stranded Copper Conductors						Aluminium Conductors					
	Current Ratings			Approximate voltage drop per ampere per metre			Current Ratings			Approximate voltage drop per ampere per metre		
	Direct in ground amps	In single way ducts amps	Installed in air amps	Ground mV	Duct mV	Air mV	Direct in ground amps	In single way ducts amps	Installed in air amps	Ground mV	Duct mV	Air mV
16	120	93	100	2.5	2.5	2.5	-	-	-	-	-	-
25	145	125	127	1.7	1.7	1.7	115	92	97	2.7	2.7	2.7
35	180	145	158	1.2	1.2	1.2	135	110	120	1.9	1.9	1.9
50	215	175	192	0.9	0.9	0.9	165	135	146	1.4	1.4	1.4
70	265	215	246	0.6	0.6	0.6	200	165	187	1.0	1.0	1.0
95	315	255	298	0.5	0.5	0.5	240	195	227	0.7	0.7	0.7
120	365	300	346	0.4	0.4	0.4	275	225	263	0.6	0.6	0.6
150	405	330	399	0.3	0.3	0.3	310	255	304	0.5	0.5	0.5
185	465	380	456	0.3	0.3	0.3	350	290	347	0.4	0.4	0.4
240	540	440	538	0.2	0.2	0.2	415	340	409	0.3	0.3	0.3
300	600	500	621	0.2	0.2	0.2	465	385	471	0.3	0.3	0.3
400	675	575	741	0.2	0.2	0.2	523	443	570	0.2	0.2	0.2

Direct in ground - Cables touching

Single way ducts - ducts touching

* Circular conductors, all others are sector shaped

Note: Unarmoured cables are as per IEC 60502 - 1

Installation conditions for above ratings:

Ambient air temperature: 30°C

Ground temperature: 15°C, Depth of laying: 0.5 m


Soil thermal resistivity: 1.2°C m/W

Maximum conductor operating temperature at rated current is 90°C

For rating factors see Tables 2 to 6 and 8 to 12

XLPE INSULATED CABLES TO BS 5467 & IEC - 60502 - 1

DIMENSIONS AND WEIGHTS

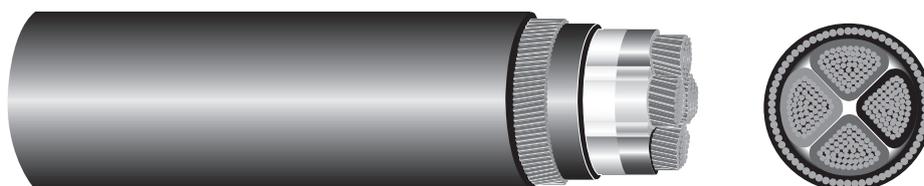

STRANDED COPPER & ALUMINIUM CONDUCTORS FOUR CORE CABLES

600/1000 V *UNARMoured AND ARMoured, PVC SHEATHED CABLES

Nominal area of conductor mm ²	Thickness of insulation mm	Unarmoured Cables (approximate values)			Armoured Cables (approximate values)				
		Cable diameter overall mm	Cable weight Aluminium kg/km	Cable weight Copper kg/km	Diameter under armour mm	Armour** wire diameter mm	Cable diameter overall mm	Cable weight Aluminium kg/km	Cable weight Copper kg/km
16*	0.7	20.0	-	780	18.0	1.25	23.4	-	1320
25	0.9	21.0	520	1160	20.0	1.6	26.1	1200	1840
35	0.9	24.5	650	1540	22.8	1.6	28.6	1420	2310
50	1.0	26.5	900	2100	25.5	1.6	32.0	1770	2970
70	1.1	31.0	1210	2950	29.5	2.0	37.7	2500	4240
95	1.1	35.2	1550	3970	33.5	2.0	41.7	2980	5400
120	1.2	39.0	1910	4960	37.5	2.5	47.1	3950	7000
150	1.4	43.5	2410	6160	41.5	2.5	51.4	4600	8350
185	1.6	49.0	2990	7690	46.0	2.5	56.6	5430	10130
240	1.7	54.5	3890	10070	52.5	2.5	63.0	6660	12840
300	1.8	61.0	4730	12490	57.5	2.5	68.8	7770	15530
400	2.0	67.5	5780	15620	65.0	3.15	78.1	10380	19950
500**	2.2	74.2	7500	19900	72.6	3.15	82.0	12200	24360

* Circular conductors, all others are sector shaped.

** Cable as per IEC 60502 - 1

Note: Unarmoured cables & cables with Stranded Aluminium Conductors conform to IEC 60502 - 1

CURRENT RATINGS (AC)

STRANDED COPPER & ALUMINIUM CONDUCTORS – FOUR CORE CABLES

600/1000 V ARMoured PVC SHEATHED CABLES

Nominal area of conductor mm ²	Stranded Copper Conductors						Aluminium Conductors					
	Current Ratings			Approximate voltage drop per ampere per metre			Current Ratings			Approximate voltage drop per ampere per metre		
	Direct in ground amps	In single way ducts amps	Installed in air amps	Ground mV	Duct mV	Air mV	Direct in ground amps	In single way ducts amps	Installed in air amps	Ground mV	Duct mV	Air mV
16	115	94	99	2.5	2.5	2.5	89	72	74	4.2	4.2	4.2
25	150	125	131	1.7	1.7	1.7	115	94	98	2.7	2.7	2.7
35	180	150	162	1.2	1.2	1.2	135	110	120	1.9	1.9	1.9
50	215	175	197	0.9	0.9	0.9	165	135	145	1.4	1.4	1.4
70	265	215	251	0.6	0.6	0.6	200	165	185	1.0	1.0	1.0
95	315	260	304	0.5	0.5	0.5	240	200	224	0.7	0.7	0.7
120	360	300	353	0.4	0.4	0.4	275	230	264	0.6	0.6	0.6
150	405	335	406	0.3	0.3	0.3	310	255	305	0.5	0.5	0.5
185	460	380	463	0.3	0.3	0.3	350	295	350	0.4	0.4	0.4
240	530	440	546	0.2	0.2	0.2	410	340	418	0.3	0.3	0.3
300	590	495	628	0.2	0.2	0.2	460	385	488	0.3	0.3	0.3
400	667	570	728	0.2	0.2	0.2	520	443	562	0.2	0.2	0.2
500	720	605	800	0.2	0.2	0.2	561	470	618	0.2	0.2	0.2

600/1000 V UNARMoured PVC SHEATHED CABLES

Nominal area of conductor mm ²	Stranded Copper Conductors						Aluminium Conductors					
	Current Ratings			Approximate voltage drop per ampere per metre			Current Ratings			Approximate voltage drop per ampere per metre		
	Direct in ground amps	In single way ducts amps	Installed in air amps	Ground mV	Duct mV	Air mV	Direct in ground amps	In single way ducts amps	Installed in air amps	Ground mV	Duct mV	Air mV
16	120	93	100	2.5	2.5	2.5	89	72	74	4.2	4.2	4.2
25	145	125	127	1.7	1.7	1.7	115	92	97	2.7	2.7	2.7
35	180	145	158	1.2	1.2	1.2	135	110	120	1.9	1.9	1.9
50	215	175	192	0.9	0.9	0.9	165	135	146	1.4	1.4	1.4
70	265	215	246	0.6	0.6	0.6	200	165	187	1.0	1.0	1.0
95	315	255	298	0.5	0.5	0.5	240	195	227	0.7	0.7	0.7
120	365	300	346	0.4	0.4	0.4	275	225	263	0.6	0.6	0.6
150	405	330	399	0.3	0.3	0.3	310	255	304	0.5	0.5	0.5
185	465	380	456	0.3	0.3	0.3	350	290	347	0.4	0.4	0.4
240	540	440	538	0.2	0.2	0.2	415	340	409	0.3	0.3	0.3
300	600	500	621	0.2	0.2	0.2	465	385	471	0.3	0.3	0.3
400	675	575	741	0.2	0.2	0.2	523	443	570	0.2	0.2	0.2
500	730	610	814	0.2	0.2	0.2	565	470	626	0.2	0.2	0.2

Direct in ground - Cables touching

Single way ducts - ducts touching

* Circular conductors, all others are sector shaped

Note: Unarmoured cables are as per IEC 60502 - 1

Installation conditions for above ratings:

Ambient air temperature: 30°C

Ground temperature: 15°C, Depth of laying: 0.5 m


Soil thermal resistivity: 1.2°C m/W

Maximum conductor operating temperature at rated current is 90°C

For rating factors see Tables 2 to 6 and 8 to 12

XLPE INSULATED CABLES TO BS 5467 & IEC - 60502 - 1

DIMENSIONS AND WEIGHTS

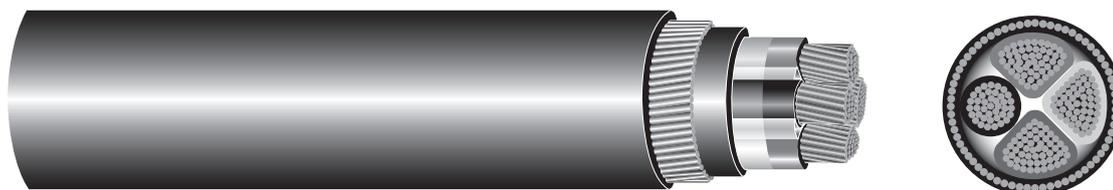

STRANDED COPPER & ALUMINIUM CONDUCTORS FOUR CORE CABLES WITH REDUCED NEUTRAL CONDUCTOR

600/1000 V *UNARMoured AND ARMoured, PVC SHEATHED CABLES

Nominal area of conductor mm ²	Nominal area of neutral conductor mm ²	Thickness of insulation mm	Unarmoured Cables (approximate values)			Armoured Cables (approximate values)				
			Cable diameter overall mm	Cable weight Aluminium kg/km	Cable weight Copper kg/km	Diameter under armour mm	Armour** wire diameter mm	Cable diameter overall mm	Cable weight Aluminium kg/km	Cable weight Copper kg/km
25	16*	0.9	21.4	-	1070	19.1	1.6	26.1	-	1750
35	16*	0.9	23.2	-	1360	22.0	1.6	27.9	-	2130
50	25*	1.0	26.1	860	1920	24.5	1.6	31.2	1710	2770
70	35*	1.1	30.4	1080	2610	28.5	2.0	36.6	2340	3870
95	50	1.1	34.8	1390	3500	32.0	2.0	41.0	2800	4910
120	70	1.2	39.4	1820	4540	35.5	2.0	45.3	3340	6060
150	70*	1.4	42.5	2190	5440	39.5	2.5	50.0	4360	7610
185	95	1.6	47.7	2630	6760	43.5	2.5	55.3	5020	9150
240	120*	1.7	53.4	3500	8900	50.2	2.5	61.1	6220	11620
300	150*	1.8	59.0	4240	11000	55.0	2.5	66.7	7220	13980
400	185*	2.0	67.0	5560	13900	62.5	3.15	73.8	9950	18250
500**	240*	2.2	74.0	6700	17560	68.8	3.15	83.9	11200	22000

* Circular conductors, all others are sector shaped.

** Cable as per IEC 60502 - 1

Note: Unarmoured cables & cables with Stranded Aluminium Conductors conform to IEC 60502 - 1

CURRENT RATINGS (AC)

STRANDED COPPER & ALUMINIUM CONDUCTORS FOUR CORE CABLES WITH REDUCED NEUTRAL CONDUCTOR

600/1000 V ARMOURED PVC SHEATHED CABLES

Nominal area of conductor mm ²	Nominal area of neutral conductor mm ²	Stranded Copper Conductors						Aluminium Conductors					
		Current Ratings			Approximate voltage drop per ampere per metre			Current Ratings			Approximate voltage drop per ampere per metre		
		Direct in ground amps	In single way ducts amps	Installed in air amps	Ground mV	Duct mV	Air mV	Direct in ground amps	In single way ducts amps	Installed in air amps	Ground mV	Duct mV	Air mV
25	16*	150	125	131	1.7	1.7	1.7	115	94	98	2.7	2.7	2.7
35	16*	180	150	162	1.2	1.2	1.2	135	110	120	1.9	1.9	1.9
50	25*	215	175	197	0.9	0.9	0.9	165	135	145	1.4	1.4	1.4
70	35*	265	215	251	0.6	0.6	0.6	200	165	185	1.0	1.0	1.0
95	50	315	260	304	0.5	0.5	0.5	240	200	224	0.7	0.7	0.7
120	70	360	300	353	0.4	0.4	0.4	275	230	264	0.6	0.6	0.6
150	70*	405	335	406	0.3	0.3	0.3	310	255	305	0.5	0.5	0.5
185	95	460	380	463	0.3	0.3	0.3	350	295	350	0.4	0.4	0.4
240	120*	530	440	546	0.2	0.2	0.2	410	340	418	0.3	0.3	0.3
300	150*	590	495	628	0.2	0.2	0.2	460	385	488	0.3	0.3	0.3
400	185*	667	570	728	0.2	0.2	0.2	520	443	562	0.2	0.2	0.2
500	240*	720	605	800	0.2	0.2	0.2	561	470	618	0.2	0.2	0.2

600/1000 V UNARMOURED PVC SHEATHED CABLES

Nominal area of conductor mm ²	Nominal area of neutral conductor mm ²	Stranded Copper Conductors						Aluminium Conductors					
		Current Ratings			Approximate voltage drop per ampere per metre			Current Ratings			Approximate voltage drop per ampere per metre		
		Direct in ground amps	In single way ducts amps	Installed in air amps	Ground mV	Duct mV	Air mV	Direct in ground amps	In single way ducts amps	Installed in air amps	Ground mV	Duct mV	Air mV
25	16*	145	125	127	1.7	1.7	1.7	115	92	97	2.7	2.7	2.7
35	16*	180	145	158	1.2	1.2	1.2	135	110	120	1.9	1.9	1.9
50	25*	215	175	192	0.9	0.9	0.9	165	135	146	1.4	1.4	1.4
70	35*	265	215	246	0.6	0.6	0.6	200	165	187	1.0	1.0	1.0
95	50	315	255	298	0.5	0.5	0.5	240	195	227	0.7	0.7	0.7
120	70	365	300	346	0.4	0.4	0.4	275	225	263	0.6	0.6	0.6
150	70*	405	330	399	0.3	0.3	0.3	310	255	304	0.5	0.5	0.5
185	95	465	380	456	0.3	0.3	0.3	350	290	347	0.4	0.4	0.4
240	120*	540	440	538	0.2	0.2	0.2	415	340	409	0.3	0.3	0.3
300	150*	600	500	621	0.2	0.2	0.2	465	385	471	0.3	0.3	0.3
400	185*	675	575	741	0.2	0.2	0.2	523	443	570	0.2	0.2	0.2
500	240*	730	610	814	0.2	0.2	0.2	565	470	626	0.2	0.2	0.2

Direct in ground - Cables touching

Single way ducts - ducts touching

* Circular conductors, all others are sector shaped

Note: Unarmoured cables are as per IEC 60502 - 1

Installation conditions for above ratings:

Ambient air temperature: 30°C

Ground temperature: 15°C, Depth of laying: 0.5 m

Soil thermal resistivity: 1.2°C m/W

Maximum conductor operating temperature at rated current is 90°C

For rating factors see Tables 2 to 6 and 8 to 12

XLPE INSULATED CABLES TO BS 5467 & IEC - 60502 - 1

CURRENT RATINGS (AC) AND VOLT DROPS

STRANDED COPPER CONDUCTORS

600/1000 V THREE AND FOUR CORE ARMoured, PVC SHEATHED CABLES

Conductor size mm ²	Current in air A	Voltage drop mV/A/m	Current in ground A	Conductor size mm ²	Current in air A	Voltage drop mV/A/m	Current in ground A
16	99	2.50	115	50	197	0.865	215
	97	2.50	112		190	0.852	210
	93	2.47	110		180	0.839	200
	89	2.43	105		175	0.826	195
	84	2.39	100		165	0.813	190
	80	2.35	97		155	0.800	185
	74	2.31	94		145	0.787	175
	68	2.27	89		135	0.774	165
	62	2.23	84		120	0.761	155
25	131	1.65	150	70	251	0.607	265
	130	1.59	145		240	0.599	260
	125	1.56	140		230	0.589	250
	120	1.54	135		220	0.580	245
	110	1.51	130		210	0.572	235
	105	1.49	125		195	0.562	225
	99	1.46	120		185	0.554	215
	91	1.44	115		170	0.545	205
	82	1.41	110		150	0.536	195
35	162	1.15	180	95	304	0.446	315
	155	1.15	175		295	0.439	305
	150	1.13	170		290	0.433	300
	145	1.11	165		270	0.427	290
	135	1.09	160		255	0.421	280
	130	1.08	150		240	0.415	270
	120	1.06	145		225	0.408	255
	110	1.04	140		210	0.402	245
	100	1.02	130		190	0.396	230

Conductor size mm ²	Current in air A	Voltage drop mV/A/m	Current in ground A
120	353	0.366	360
	340	0.357	350
	325	0.352	340
	310	0.347	330
	300	0.342	320
	280	0.337	305
	260	0.333	295
	240	0.328	280
	215	0.323	260
150	406	0.303	405
	395	0.299	395
	375	0.295	385
	365	0.292	370
	345	0.288	360
	325	0.284	345
	305	0.280	330
	280	0.277	315
	250	0.273	295
185	463	0.255	460
	450	0.252	450
	430	0.249	435
	415	0.246	420
	395	0.243	405
	370	0.240	390
	345	0.237	375
	320	0.235	355
	290	0.232	335

Conductor size mm ²	Current in air A	Voltage drop mV/A/m	Current in ground A
240	546	0.211	530
	530	0.208	515
	510	0.206	500
	490	0.204	485
	465	0.203	470
	440	0.200	450
	410	0.199	430
	375	0.197	410
	340	0.195	385
300	628	0.185	590
	605	0.183	575
	580	0.181	560
	555	0.180	540
	530	0.179	520
	500	0.177	500
	465	0.176	480
	430	0.174	455
	390	0.174	430
400	728	0.166	667
	715	0.163	640
	685	0.162	620
	655	0.161	600
	620	0.160	580
	585	0.159	560
	545	0.158	535
	500	0.157	505
	450	0.156	475

Installation conditions for above ratings:
 Ambient temperature: 30°C Ground Temperature: 15°C
 Soil Thermal resistivity: 1.2°Cm/W
 Depth of laying: 0.5 m

XLPE INSULATED CABLES TO BS 5467 & IEC - 60502 - 1

DIMENSIONS AND WEIGHTS

1900/3300 V

ARMoured PVC SHEATHED CABLES

Stranded Copper Conductors - Single core cables						Stranded Copper Conductors - Three core cables					
Approximate Values						Approximate Values					
Nominal area of conductor	Thickness of insulation	Diameter under armour	Armour** wire diameter	Cable diameter overall	Cable weight copper	Nominal area of conductor	Thickness of insulation	Diameter under armour	Armour** wire diameter	Cable diameter overall	Cable weight copper
mm ²	mm	mm	mm	mm	kg/km	mm ²	mm	mm	mm	mm	kg/km
50	2.0	15.0	1.6*	20.6	810	16*	2.0	21.5	1.6	29.3	1600
70	2.0	16.6	1.6*	22.4	1040	25*	2.0	24.5	1.6	32.2	2060
95	2.0	18.4	1.6*	24.3	1330	35*	2.0	26.5	1.6	34.8	2400
120	2.0	19.8	1.6	27.2	1680	50	2.0	25.2	2.0	34.7	3200
150	2.0	21.2	1.6	28.8	1970	70	2.0	28.4	2.0	38.0	3800
185	2.0	23.0	1.6	30.8	2370	95	2.0	31.0	2.0	41.4	4730
240	2.0	25.5	1.6	33.5	2960	120	2.0	36.6	2.5	45.7	6070
300	2.0	27.7	1.6	36.1	3610	150	2.0	38.5	2.5	48.5	7010
400	2.0	31.0	2.0	40.5	4600	185	2.0	42.5	2.5	51.9	8270
500	2.2	36.0	2.0	44.2	5680	240	2.0	47.8	2.5	56.9	10310
630	2.4	40.0	2.0	48.8	7160	300	2.0	51.4	2.5	61.2	12300
800	2.6	45.8	2.5	55.4	9150	-	-	-	-	-	-
1000	2.8	50.8	2.5	60.6	11270	-	-	-	-	-	-

* Circular conductors, all others are sector shaped

1900/3300 V

ARMoured PVC SHEATHED CABLES

Approximate Values				Approximate Values			
Nominal area of conductor mm ²	Direct in ground amps	In single way ducts amps	Installed in air amps	Nominal area of conductor mm ²	Direct in ground amps	In single way ducts amps	Installed in air amps
50	222	219	228	16	114	96	106
70	271	264	285	25	147	124	142
95	324	310	350	35	175	147	168
120	366	342	407	50	207	174	202
150	409	376	463	70	254	214	255
185	460	414	528	95	304	257	312
240	528	464	623	120	345	293	361
300	589	506	710	150	387	328	410
400	651	535	808	185	436	371	471
500	720	579	915	240	502	428	554
630	789	624	1030	300	563	480	634
800	831	650	1119	-	-	-	-
1000	880	689	1214	-	-	-	-

Direct in ground - Trefoil touching, Single way ducts - ducts touching
Spacing in air - As shown above (D=Cable diameter)

*Wire diameters are larger than those specified in BS 5467

**Aluminium wire armour for AC system

Installation conditions for above ratings:

Ambient air temperature: 30°C Ground temperature: 15°C

Depth of laying: 0.5 m, Soil thermal resistivity: 1.2°C m/W

Maximum conductor operating temperature at rated current is 90°C

XLPE INSULATED CABLES TO BS 5467 & IEC - 60502 - 1

DIMENSIONS AND WEIGHTS

Lead Sheathed Armoured Power Cables to BS 5467 and EEMUA 133

600/1000 V

	Approximate diameter					Approximate weight kg/km	
	Nominal area of conductor mm ²	Nominal lead sheath mm	Over lead mm	Armour Wire mm	Overall cable mm		
Single	50*	1.1	13.0	1.6	20.8	1300	
	70*	1.1	15.0	1.6	22.6	1620	
	95*	1.1	16.8	1.6	24.5	2040	
	120*	1.2	18.5	1.6	26.2	2380	
	150	1.2	20.5	1.6	28.5	2840	
	185	1.3	22.8	1.6	30.8	3365	
	240	1.4	25.5	1.6	33.5	4180	
	300	1.4	28.1	1.6	36.4	5060	
	400	1.6	32.3	2.0	41.8	6400	
	500	1.7	37.0	2.0	46.6	8000	
Three	630	1.8	40.8	2.0	50.8	9720	
	800	2.0	47.5	2.5	59.2	12700	
	1000	2.1	52.5	2.5	64.2	15400	
	Two	16	1.1	15.5	1.25	21.8	1540
		25	1.2	18.9	1.25	25.5	2060
		35*	1.3	21.3	1.6	29.4	2670
		50	1.2	19.0	1.6	27.2	2640
		70	1.3	22.2	1.6	30.5	3400
		95	1.4	24.8	2.0	34.5	4530
		120	1.4	27.2	2.0	37.8	5170
150		1.5	30.3	2.0	41.1	6120	
185		1.6	33.7	2.5	46.3	7710	
240		1.8	38.9	2.5	51.7	9650	
Three	300	1.9	42.9	2.5	56.3	11510	
	Four	16	1.1	16.5	1.25	23.0	1750
		25	1.2	20.5	1.6	28.6	2650
		35	1.3	23.0	1.6	31.2	3220
		50*	1.3	24.0	1.6	32.0	3630
		70	1.4	26.5	1.6	35.0	4560
		95	1.5	30.5	2.0	40.5	6110
		120	1.6	33.5	2.0	43.5	7300
		150	1.7	37.8	2.5	49.4	8980
		185	1.9	42.8	2.5	54.5	10870
240		2.0	48.2	2.5	60.2	13500	
Five	300	2.2	52.2	2.5	65.2	16150	
	400	2.3	57.8	2.5	71.8	19550	

كابلات الجهد المنخفض XLPE Insulated Low Voltage Cables

	Approximate diameter					Approximate weight kg/km
	Nominal area of conductor mm ²	Nominal lead sheath mm	Over lead mm	Armour Wire mm	Overall cable mm	
F o u r c o r e	16	1.2	18.8	1.25	25.5	2120
	25*	1.2	20.5	1.6	28.5	2800
	35	1.3	23.2	1.6	31.3	3430
	50	1.4	26.2	1.6	34.6	4260
	70	1.5	30.5	2.0	40.5	5850
	95	1.6	34.8	2.0	44.8	7340
	120	1.7	37.8	2.5	49.8	9400
	150	1.9	43.2	2.5	55.0	11280
	185	2.0	47.8	2.5	60.0	13600
	240	2.2	53.8	2.5	66.5	17000
e	300	2.3	58.5	2.5	72.5	20150
	400	2.5	65.9	3.15	82.6	26100

* Cable with 1.6mm wire armour, a deviation from BS 5467. Tolerance on the above dimensions are -0.3mm and +0.5mm. Cable sizes marked + and higher have sector shaped conductors.

Lead sheath thicknesses are nominal values based on EEMUA 133. For 2 core cables, 50 mm² and above have D-shaped conductors.

XLPE INSULATED CABLES TO BS 5467 & IEC - 60502 - 1

DIMENSIONS AND WEIGHTS

Lead Sheathed Armoured Power Cables to BS 5467 and EEMUA 133

1900/3300 V

	Approximate diameter					Approximate weight kg/km
	Nominal area of conductor mm ²	Nominal lead sheath mm	Over lead mm	Armour Wire mm	Overall cable mm	
T h r e e c o r e	16	1.3	22.9	1.6	31.8	2750
	25	1.4	26.1	1.6	34.9	3412
	35	1.5	28.6	1.6	37.6	4045
	50*	1.5	29.8	2.0	40.2	4822
	70	1.5	31.1	2.0	41.7	5560
	95	1.6	32.7	2.0	43.5	6582
	120	1.7	38.0	2.5	50.4	8440
	150	1.8	39.8	2.5	52.7	9540
	185	1.9	43.8	2.5	56.6	11272
	240	2.0	48.9	2.5	62.3	13819
e	300	2.2	53.3	2.5	66.9	16456

* Cable sizes 50 mm² and higher have sector shaped conductors.

XLPE INSULATED CABLES TO BS 5467 & IEC - 60502 - 1

RESISTANCE OF LEAD SHEATH AND ARMOUR

Lead Sheathed Armoured Power Cables to BS 5467 and EEMUA 133

1900/3300 V

Maximum Resistance (ohms) per 1000 metres of cable at 20°C										
Nominal area of conductor mm ²	600/1000 V								1900/3300 V	
	Single core		Two core		Three core		Four core		Three core	
	Lead	Armour	Lead	Armour	Lead	Armour	Lead	Armour	Lead	Armour
1.5	-	-	8.98	6.21	8.54	5.96	7.72	5.59	-	-
2.5	-	-	7.56	5.51	7.09	5.26	6.29	4.84	-	-
4	-	-	6.37	4.88	6.27	4.81	5.41	4.31	-	-
6	-	-	5.85	4.59	5.40	4.31	4.91	3.02	-	-
10	-	-	4.91	4.01	4.71	2.93	4.10	2.63	-	-
16	8.14	0.62	4.29	3.10	4.11	2.64	3.31	2.36	2.42	1.37
25	6.63	0.54	3.21	2.64	2.96	1.58	2.93	1.57	1.97	1.22
35	6.01	0.50	2.60	1.69	2.41	1.42	2.38	1.41	1.68	1.13
50	5.24	0.47	3.19	1.88	2.37	1.40	1.96	1.27	1.61	0.84
70	4.56	0.42	2.52	1.64	1.95	1.27	1.59	0.87	1.54	0.81
95	4.07	0.39	2.10	1.14	1.60	0.87	1.30	0.77	1.37	0.77
120	3.30	0.35	1.89	1.04	1.32	0.78	1.11	0.57	1.10	0.54
150	3.03	0.32	1.58	0.95	1.13	0.58	0.88	0.51	1.00	0.52
185	2.48	0.29	1.33	0.69	0.89	0.52	0.75	0.47	0.86	0.48
240	2.03	0.26	1.02	0.61	0.76	0.47	0.61	0.42	0.73	0.43
300	1.86	0.24	0.87	0.55	0.62	0.42	0.53	0.38	0.61	0.40
400	1.41	0.17	-	-	0.53	0.39	0.43	0.26	0.53	0.37
500	1.16	0.15	-	-	-	-	-	-	-	-
630	0.98	0.13	-	-	-	-	-	-	-	-
800	0.76	0.09	-	-	-	-	-	-	-	-
1000	0.65	0.08	-	-	-	-	-	-	-	-

Note: Single core cables with Aluminium Wire Armour and Multicore cables with Steel Wire Armour

XLPE CABLE DATA FOR PARTIAL LOAD

For installations where XLPE insulated cables are not fully loaded and conductor operating temperatures are below 90°C.

The current ratings given in relevant tables of this publication assume that cables are fully loaded i.e. conductor operating temperature is 90°C and conductor resistances at this temperature have been used in the tabulated figures of volt drop per ampere per metre for various sizes of cables.

In many situations the conductor size which is ultimately chosen may not be carrying its maximum permissible current (i.e. its full rated current) and consequently it will not be operating at its maximum designed temperature. Table 31 shows the reduced voltage drop / ampere/metre/ data corresponding to reduced operating temperature due to reduced load currents. The first line is applicable to 90°C conductor temperature. Examples are given below to illustrate situations where over-designing can be avoided. "Standard conditions" in the following refer to those obtained in the United Kingdom on which the current rating /voltage drop tables are based. For situations other than "standard conditions" such as those in the Middle East, suitable rating factors can be applied for utilising data in Table 31 as shown in example (3) in the following:

It should also be ensured that the cable size ultimately selected is capable of carrying the required current under site conditions of installation.

$$\text{Formula } V_d = \frac{mV \times I \times L}{1000} \quad \text{or} \quad mV = \frac{V_d \times 1000}{I \times L}$$

where V_d = maximum acceptable volt drop (in volts)
 I = current per phase (in amps)
 mV = appropriate volt drop (in mV/amp/metre)
 L = route length (in metres)

Examples: At standard defined conditions:

- 1) Consider a route of 120 metres of four core copper XLPE/SWA/PVC to be installed in air (at standard conditions) and to carry 300 amps per phase at 415 volts. Maximum voltage drop to be 2.5 per cent.

$$2.5 \text{ per cent of } 415 \text{ V} = 10.4 \text{ V}$$

Substitute for current, route length and maximum volt drop

$$mV = \frac{10.4 \times 1000}{300 \times 120} = 0.289 \text{ mV/A/m}$$

From Table 31, the first line of figures per conductor size (corresponding to IEE Wiring Regulations) and giving a voltage drop value less than 0.289 is 185 mm². By studying the table to find a voltage drop value equal to, or less than the

0.289 calculated, but at the same time representing the 300 A load required, it will be seen that a voltage drop of 0.280 corresponds to a current of 305 A and a reduced conductor size of 150 mm². Therefore it is possible to select a 150 mm² cable rather than the 185 mm² cable first indicated.

The actual volt drop of this installation is

$$V_d = \frac{300 \times 120 \times 0.280}{1000} = 10.1 \text{ V}$$

- 2) Consider a route of 130 metres of four core copper XLPE /SWA/PVC cable to be installed partly in air, partly underground, and to carry 260 amps per phase at 380 V. Maximum voltage drop to be 3%. 3% of 380 V = 11.4 V Substitute for current, route length and maximum volt drop

$$mV = \frac{11.4 \times 1000}{260 \times 130} = 0.337 \text{ mV/A/m}$$

Selecting a voltage drop corresponding to the maximum rating the size would be 150 mm² but selecting from

Table 31 such that mV/A/m is equal to, or less than the 0.337 calculated and is capable of carrying 260 A (in ground and in air), it will be seen that this value is 0.333 for a 120 mm² cable (instead of 150 mm²).

$$\text{and the actual voltage drop} = \frac{260 \times 130 \times 0.333}{1000} = 11.3 \text{ V}$$

(See Tables for site conditions other than standard defined conditions)

Examples: At site conditions other than standard defined conditions

3) Consider example (1) but at an ambient temperature of 45°C. Derating factor for this temp. = 0.87 (see Table 12). Using this factor, calculate the 'equivalent current' at standard conditions by dividing the actual current by the derating factor.

$$\text{Thus 'equivalent current'} = \frac{300}{0.87} = 345 \text{ A}$$

and from previous example (1) the mV/A/m figure needs to be 0.289 or less.

Selecting a cable from Max Rating figures as previously - the cable would be 185 mm².

However selecting from Table 31 with a current of 345A and a volt drop of 0.289 (or less), gives a cable size of 150 mm² with a voltage drop value of 0.288 mV/A/m at 345A. (instead of the 185 mm²).

$$\text{and the actual voltage drop} = \frac{300 \times 120 \times 0.288}{1000} = 10.4 \text{ V}$$

XLPE INSULATED CABLES TO BS 5467 & IEC - 60502 - 1

Nominal Con. Area mm ²	No. of cores	Thread Size mm	BW Indoor Gland Kit Reference	CW Outdoor Gland Kit Reference	E1W Outdoor Gland Kit Reference	E1WF E.Exd Gland Kit Reference	EXCEL PLUS Deluge-proof Gland Reference	BARR-W Explosion Proof Gland Reference	Teicleat Ref. 385AA	Ranger Cleat Ref. 382AA	Aluminium Claw & 2 Bolt Cleat Ref. 370BA	Easypac Resin Joint	Copper Connectors Lugs
	2	20	BW20SK	CW20SSK	KA413-71	KA472-71	493AB-71	424AA-52	01	-	01	PUJ2CC	BT2C-
	3	20	BW20SK	CW20SSK	KA413-71	KA472-71	493AB-71	424AA-52	01	-	01	PUJ2CC	BT2C-
	4	20	BW20SK	CW20SK	KA413-52	KA472-52	493AB-52	424AA-52	01	01	02	PUJ2CC	BT2C-
	7	20	BW20K	CW20K	KA413-52	KA472-52	493AB-52	424AA-53	02	01	02	PUJ2CC	BT2C-
1.5	12	20/25	BW25K	CW25K	KA413-55	KA472-55	493AB-53	424AA-55	03	02	04	PUJ6CC	BT2C-
	19	25	BW25K	CW25K	KA413-55	KA472-55	493AB-55	424AA-55	04	03	05	PUJ6CC	BT2C-
	27	25/32	BW32K	CW32K	KA413-55	KA472-55	493AB-56	424AA-56	05	03	06	PUJ6CC	BT2C-
	37	32	BW32K	CW32K	KA413-56	KA472-56	493AB-56	424AA-56	06	04	06	PUJ16CC	BT2C-
	48	40	BW40K	CW40K	KA413-57	KA472-57	493AB-57	424AA-57	07	05	07	PUJ25CC	BT2C-
	2	20	BW20SK	CW20SK	KA413-52	KA472-52	493AB-52	424AA-52	01	01	02	PUJ2CC	BT2C-
	3	20	BW20SK	CW20SK	KA413-52	KA472-52	493AB-52	424AA-52	01	01	02	PUJ2CC	BT2C-
	4	20	BW20SK	CW20SK	KA413-52	KA472-52	493AB-52	424AA-52	02	01	02	PUJ2CC	BT2C-
2.5	7	20	BW20K	CW20K	KA413-53	KA472-53	493AB-53	424AA-53	03	01	03	PUJ6CC	BT2C-
	12	25	BW25K	CW25K	KA413-55	KA472-55	493AB-55	424AA-55	04	03	05	PUJ6CC	BT2C-
	19	25/32	BW25K	CW25K	KA413-55	KA472-55	493AB-55	424AA-56	05	03	06	PUJ25CC	BT2C-
	27	32	BW32K	CW32K	KA413-56	KA472-56	493AB-56	424AA-56	06	04	06	PUJ25CC	BT2C-
	37	40	BW40K	CW40K	KA413-57	KA472-57	493AB-57	424AA-57	06	04	07	PUJ25CC	BT2C-
	2	20	BW20SK	CW20SK	KA413-52	KA472-52	493AB-52	424AA-52	02	01	02		BT6C-
4	3	20	BW20SK	CW20SK	KA413-52	KA472-52	493AB-52	424AA-52	02	01	02	PUJ6CC	BT6C-
	4	20	BW20K	CW20K	KA413-53	KA472-53	493AB-53	424AA-53	03	01	03		BT6C-

Nominal Con. Area mm ²	No. of cores	Thread Size mm	BW Indoor Gland Kit Reference	CW Outdoor Gland Kit Reference	E1W Outdoor Gland Kit Reference	E1WF E.Exd Gland Kit Reference	EXCEL PLUS Deluge-proof Gland Reference	BARR-W Explosion Proof Gland Reference	Telcleat Ref. 385AA	Ranger Cleat Ref. 382AA	Aluminium Claw & 2 Bolt Cleat Ref. 370BA	Easypac Resin Joint	Copper Connectors Lugs
	2	20	BW20K	CW20K	KA413-52	KA472-52	493AB-53	424AA-53	03	01	03		BT6C-
6	3	20	BW20K	CW20K	KA413-53	KA472-53	493AB-53	424AA-53	03	01	03	PUJ6CC	BT6C-
	4	20	BW20K	CW20K	KA413-53	KA472-53	493AB-53	424AA-53	04	02	04		BT6C-
	2	20	BW20K	CW20K	KA413-53	KA472-53	493AB-53	424AA-53	04	02	04		BT10C-
10	3	20/25	BW20K	CW20K	KA413-53	KA472-53	493AB-53	424AA-55	04	02	04	PUJ10CC	BT10C-
	4	25	BW25K	CW25K	KA413-55	KA472-55	493AB-55	424AA-55	04	03	05		BT10C-
	2	25	BW25K	CW25K	KA413-55	KA472-55	493AB-55	424AA-55	04	03	04		BT16C-
16	3	25	BW25K	CW25K	KA413-55	KA472-55	493AB-55	424AA-55	04	03	05	PUJ16CC	BT16C-
	4	25	BW25K	CW25K	KA413-55	KA472-55	493AB-55	424AA-55	05	03	06		BT16C-
	2	25	BW25K	CW25K	KA413-55	KA472-55	493AB-55	424AA-55	05	03	05		BT25C-
25	3	32	BW32K	CW32K	KA413-56	KA472-56	493AB-56	424AA-56	05	03	06	PUJ25CC	BT25C-
	4	32	BW32K	CW32K	KA413-56	KA472-56	493AB-56	424AA-56	06	04	06		BT25C-
	2	32	BW32K	CW32K	KA413-56	KA472-56	493AB-56	424AA-56	05	04	06		BT35C-
35	3	32	BW32K	CW32K	KA413-56	KA472-56	493AB-56	424AA-56	06	04	06	PUJ35CC	BT35C-
	4	32/40	BW32K	CW32K	KA413-56	KA472-56	493AB-56	424AA-57	06	04	07		BT35C-
	2	25/32	BW25K	CW25K	KA413-55	KA472-55	493AB-55	424AA-56	05	03	06		BT50C-
50	3	32	BW32K	CW32K	KA413-56	KA472-56	493AB-56	424AA-56	06	04	06	PUJ50CC	BT50C-
	4	32	BW32K	CW32K	KA413-56	KA472-56	493AB-56	424AA-56	06	04	06		BT50C-
	2	32	BW32K	CW32K	KA413-56	KA472-56	493AB-56	424AA-56	05	04	06		BT70C-
70	3	32	BW32K	CW32K	KA413-56	KA472-56	493AB-56	424AA-56	06	04	07	PUJ70CC	BT70C-
	4	40	BW40K	CW40K	KA413-57	KA472-57	493AB-57	424AA-57	07	04	07		BT70C-
	2	32	BW32K	CW32K	KA413-56	KA472-56	493AB-56	424AA-56	06	04	06		BT95C-
95	3	40	BW40K	CW40K	KA413-57	KA472-57	493AB-57	424AA-57	07	04	07	PUJ95CC	BT95C-

كابلات الجهد المنخفض XLPE Insulated Low Voltage Cables

Nominal Con. Area mm ²	No. of cores	Thread Size mm	BW Indoor Gland Kit Reference	CW Outdoor Gland Kit Reference	E1W Outdoor Gland Kit Reference	E1WF E.Exd Gland Kit Reference	EXCEL PLUS Deluge-proof Gland Reference	BARR-W Explosion Proof Gland Reference	Teiclear Ref. 385AA	Ranger Cleat Ref. 382AA	Aluminium Claw & 2 Bolt Cleat Ref. 370BA	Easypac Resin Joint	Copper Connectors Lugs
	4	50	BW50K	CW50K	KA413-58	KA472-58	493AB-57	424AA-59	08	05	08		BT95C-
	2	40	BW40K	CW40K	KA413-57	KA472-57	493AB-57	424AA-57	07	04	07		BT120C-
120	3	40/50	BW50K	CW50K	KA413-57	KA472-57	493AB-57	424AA-59	07	05	08	PUJ120CC	BT120C-
	4	50	BW50K	CW50K	KA413-58	KA472-58	493AB-59	424AA-59	08	05	09		BT120C-
150	2	40	BW40K	CW40K	KA413-57	KA472-57	493AB-57	424AA-57	07	05	08		BT150C-
	3	50	BW50K	CW50K	KA413-58	KA472-58	493AB-59	424AA-59	08	05	09	PUJ150CC	BT150C-
	4	50	BW50K	CW50K	KA413-59	KA472-59	493AB-59	424AA-59	08	05	09		BT150C-
	2	50	BW50K	CW50K	KA413-58	KA472-58	493AB-59	424AA-59	08	05	08		BT185C-
185	3	50	BW50K	CW50K	KA413-59	KA472-59	493AB-59	424AA-59	08	05	09	PUJ185CC	BT185C-
	4	63	BW63K	CW63K	KA413-60	KA472-60	493AB-61	424AA-61	-	06	10		BT185C-
240	2	50	BW50K	CW50K	KA413-59	KA472-59	493AB-59	424AA-59	08	05	09		BT240C-
	3	63	BW63K	CW63K	KA413-60	KA472-60	493AB-61	424AA-61	-	06	10	PUJ240CC	BT240C-
	4	63	BW63K	CW63K	KA413-61	KA472-61	493AB-61	424AA-61	-	06	11		BT240C-
	2	50/63	BW50K	CW50K	KA413-59	KA472-59	493AB-59	424AA-61	-	06	10		BT300C-
300	3	63	BW63K	CW63K	KA413-61	KA472-61	493AB-61	424AA-61	-	06	11	PUJ300CC	BT300C-
	4	75	BW75SK	CW75K	KA413-62	KA472-62	493AB-63	424AA-63	-	06	12		BT300C-
400	2	63	BW63K	CW63K	KA413-60	KA472-60	493AB-61	424AA-61	-	06	11		BT400C-
	3	63/75	BW75SK	CW75K	KA413-61	KA472-62	493AB-63	424AA-63	-	06	12	PUJ400CC	BT400C-
	4	75/85	BW85K	CW85K	KA413-63	KA472-63	493AB-63	424AA-64	-	06	13		BT400C-

Note: Resin Joint PUJ2CC only has four (4) connectors. For multipair cables additional connectors are required. When ordering connectors specify stud hole size required. eg. BT10C8 is a 10mm2 connector with a 8mm stud hole.
Important Note: The dimensions of cables vary with manufacturing tolerances. We advise the cable diameter is measured where possible before purchasing components. The recommendations here are given in good faith but Ducab cannot be held liable for mistakes in selection however caused.



دوكاب Ducab

Ducab Offices and Joint Ventures

Ducab - Jebel Ali Factory

P.O. Box 11529, Jebel Ali, Dubai
Tel: +971 4 815 8888, Fax: +971 4 815 8111
Email: ducab@ducab.com

Ducab Mussafah 2 Factory

P.O. Box 9171, Abu Dhabi, UAE
Tel: +971 2 550 0774, Fax: +971 2 550 0979
Email: ducab@ducab.com

Ducab Mussafah 1 Factory

P.O. Box 9171, Abu Dhabi, UAE
Tel: +971 2 502 7777, Fax: +971 2 502 7755
Email: ducab@ducab.com

Ducab HV

P O Box 683, Dubai, UAE
Tel: +971 4 815 8600, Fax: +971 4 815 8666
Email: ducab@ducab.com

Ducab - Qatar

P.O. Box 23209, Doha, Qatar
Tel: +974 4016 4070,
Fax: +974 4016 4072
Mobile: +974 3351 6218
Email: dqsales@ducab.com

Ducab - Australia

Level 3, Suite 4, 695 Burke Road
Camberwell, 3124, Victoria, Australia
Tel: +61 (0) 413 658 856
Email: ausoffice@ducab.com

Ducab - Oman

P.O. Box 3542,
112 RUWI, Muscat, Oman
Tel: +968 245 651 78, Fax: +968 245 643 02
Email: ducabomn@omantel.net.om

Dubai Cable Co (P) Ltd. (DUCAB) - KSA

403, Al-Za'abi Tower,
Prince Mohammad Bin Fahad Road, 1st Street
P.O. Box: 60662, Dammam-31555, KSA
Tel: +966 3 835 5305, Fax: +966 3 835 5307
Mobile: +966 50 825 5581
Email: mohammad.sayed@ducab.com

DUCAB - UK LTD

Durham Road, Birtley, Co.
Durham, England DH3 2RA
United Kingdom
Tel: +44 191 411 3839
Email: ducabuk@ducab.com

Ducab Joint Venture – Bahrain


BICC MET W.L.L.,
P.O. Box 11413, Manama,
Kingdom of Bahrain
Tel: +973 177 497 61,
Fax: +973 177 280 27
Email: biccmet@batelco.com.bh

Ducab Joint Venture - Qatar

JBK DUCAB W.L.L (JV)
P.O. Box 14039, Doha, Qatar
Tel: +974 4442 1924
Fax: +974 4441 9003
Email: mail@jbkducab.com.qa

AEI Cables Ltd. (Ducab Cable Group Co.)

P.O Box: Durham DH3 2RA, Durham Road
Birtley, Chester-le-Street, Co. Durham
Tel: +44 191 410 3111
Fax: +44 191 410 8312
Email: sales@aeicables.co.uk
technical@aeicables.co.uk



دوكاب - ص.ب: ١١٥٢٩ دبي الإمارات العربية المتحدة، هاتف: ٨١١١ ٨١٥ (٤-٩٧١)، فاكس: ٨١١٨ ٨١٥ (٤-٩٧١)
Ducab, P.O.Box 11529, Dubai, United Arab Emirates, Tel: (971-4) 8158888, Fax: (971-4) 8158111
e-mail: ducab@ducab.com, website: www.ducab.com, Toll Free: 800-Ducab (800-38222)